

via: email (mulhern@fotenn.com)

July 30, 2025
File: 1645.00-102

308 Wellington Street
2nd Floor
Kingston, ON K7K 7A8
Canada

613-548-3446
www.malroz.com

Brittany Mulhern, MCIP RPP
Associate
FOTENN Planning + Design
The Woolen Mill
4 Cataraqui St, Suite 315
Kingston, ON K7K 1Z7

Subject: Hydrogeological Evaluation Update for Part of Lots 19 & 20
Concession 1, Leeds and the Thousand Islands, Ontario

Dear Mr. Hamilton:

Malroz Engineering Inc. (Malroz) was retained FOTENN Planning + Design (the Client), to conduct an update to a hydrogeological evaluation that was previously completed by Oliver, Mangione, McCalla and Associates Limited¹. The evaluation was completed to address The United Counties of Leeds and Grenville's conditions and amendments to final plan approval for registration of subdivision, file no. 08-T-92002, specifically comments 23 and 24:

23. Prior to final approval, the report prepared by Oliver, Mangione, McCalla and Associates Limited entitled "Regina Residential Subdivision Hydrogeological and Terrain Analysis Report" Part of Lots 19 and 20, Concession 1 in the Township of Front of Leeds and Lansdowne, dated February 1991 and all addendums will be updated by a qualified professional to conform with current requirements. The study will also be peer reviewed by the Township's/Counties peer reviewer at the applicant's expense and any recommendations implemented through the Township's subdivision agreement with provisions to be included by the owner in all Offers of Purchase and Sale. The updated study, peer review and implementation of recommendations through the subdivision agreement must be complete prior the release of Condition 23 by the Counties and the Township.

The updated report must address the following provincial guidelines and requirements:

- a) *Guideline D-5. Planning for Sewage and Water Services. Ontario Ministry of the Environment, August 1996;*

- b) *Procedure D-5-4. Technical Guideline for Individual On-Site Sewage Systems: Water Quality Impact Risk Assessment. Ontario Ministry of the Environment, August 1996;*
- c) *Procedure D-5-5. Private Wells: Water Supply Assessment. Ontario Ministry of the Environment, August 1996.*
- d) *Retesting of any of the wells used for the original study to ensure that the water quantity and quality are adequate for the proposed development. Additional wells may be required.*
- e) *Review local land uses (including the adjacent retirement community) and include a survey of neighbouring groundwater users to determine if any potential issues with groundwater quality or quantity exist.*

24. *That the existing recommendations from the report prepared by Oliver, Mangione, McCalla and Associates Limited entitled "Regina Residential Subdivision Hydrogeological and Terrain Analysis Report", dated February 1991 are to be updated through Condition 23. At a minimum, the subdivision agreement and all Offers of Purchase and Sale will contain this letter report has been prepared to address the above noted comments.*

We understand that an updated terrain analysis will be required to support final approval, which is to be completed once lot fabric and development layout details are finalized,.

1.0 Introduction

The subject site is located on Parts of Lots 19 and 20, Concession 1 in the township of Leeds and the Thousand Islands. The subject site is bounded by Highway 401 to the north and the Thousand Islands Parkway to the south. The proposed plan includes the subdivision of the subject site into 25 single family lots as shown on the attached Draft Plan of Subdivision and Figure 1.

1.1 Review of Prior OMM&A Report

A report completed for the subject site by Oliver, Mangione, McCalla & Associates Limited (OMM&A) dated February 1991² was provided. The report contemplated 26 lots at the site and recommended approval.

The investigation included gathering geological and hydrogeological background information on the subject site from publicly available information.

² Oliver Mangione McCalla & Associates Limited, Consulting Engineers. (1991). Regina Residential Subdivision Hydrogeology & Terrain Analysis Report, Part Lots 19 & 20, Concession 1, Front of Leeds & Lansdowne Township. Kingston, Ontario.

Five water wells, (referred to herein as the test wells TWI through TWV) were installed on the site. The water wells were installed by Jack Knox Well Drilling a licensed water well contractor. A copy of the water well records (WWRs) is attached.

On-site conditions were assessed through the construction and testing of three test wells installed into bedrock at depths ranging from 35 to 38 mbg. Three six-hour pumping tests were performed on the on-site wells and two water quality samples were collected from each well, one from the beginning and one from the end of each pumping test.

The overburden conditions were investigated by advancing 21 test pits to a maximum depth of 3.3 mbg (or refusal on bedrock) across the subject site and during the drilling of the test wells.

Interviews were conducted with two neighbouring homeowners regarding their groundwater supplies, groundwater quality samples were also collected from these locations.

The conclusions enumerated in the report are summarized below:

1. The water wells records within a 5 km radius were reviewed and indicated all but three out of the 60 well records obtained exceeded the pumping rate of 13.6 L/min which was considered the minimum to supply a single-family residence.
2. Results of the on-site pumping tests indicate sufficient groundwater to supply single family residences.
3. Hydraulic interconnection was not observed between the on-site test wells and as a result unacceptable mutual well interference is not anticipated.
4. Recommendations for installation of wells on-site to prevent contamination from local infiltration of surface water.
5. For the parameters analyzed, the five wells that were tested, (three on-site and two off-site) met the criteria for chemical and bacteriological parameters related to health. The following elevated concentrations were noted:
 - a. Sodium concentrations exceeded the 20mg/L warning level, but not the 200mg/L aesthetic objective on each of the 3 wells that were tested;
 - b. Total organic nitrogen (TON) exceeded the aesthetic objective of 0.15 mg/L at TWI;
 - c. Manganese exceeded the aesthetic objective of 0.05 mg/L in TWII;
 - d. Total dissolved solids (TDS) was assumed to have exceeded the aesthetic objective of 500 mg/L based on conductivity levels above 800 μ hos in TWI and TWII.

6. Due to the type of overburden encountered on-site (mainly clay) fully raised Class IV absorption trench sewage disposal systems were recommended to meet the conditions of Ontario Regulation 374/81.

2.0 Methodology

The scope of the hydrogeological assessment included the following:

1. Inspection of each previously installed well by a licensed water well contractor.
2. Manually monitor water levels in the test wells prior to and during each pumping test.
3. Instrument the test wells, and the drinking water well located at Fox Run By The River Retirement Residence (well tag #A100275), the neighboring property to the east, with a groundwater data logger (levellogger) to automatically record water levels during the pumping tests and up to 24 hours after the tests for the duration of groundwater recovery.
4. Conduct an approximate 6-hour pumping test at four of the test wells (one more pumping test than conducted in the 1991 OMM&A Report) on test wells TWI, TWIII, TWIV, and TWV, to evaluate the yield of the wells and assess for well interference. A pumping test was not performed on TWII as it had previously been damaged.
5. Collect two water samples from the test wells (TWI, TWIII, TWIV, and TWV): one during the first hour of pumping (or when free of residual chlorine), and one during the last hour of the pumping test. Submit to an independent accredited analytical laboratory for typical subdivision suite of analyses.
6. Evaluate the water quality, quantity, and potential for well interference based on collected and available data.

The pumping tests were conducted on July 11, July 12, July 21 and July 26, 2022, by MacLellan Water Technologies (MacLellan), a licensed well contractor. The pumping tests were conducted for a total pumping time of 6 hours each. The results of the pumping tests are presented in Table 1.

To monitor for well interference, a well access request letter was sent to the property owners of the Fox Run by The River Retirement Residence. This was identified as a nearby property with likely high groundwater usage compared to a single family home. Permission to access the well (#A100275), was obtained and the well was instrumented with a levellogger.

The test well and observation well locations were surveyed using a Trimble R10 Global Navigation Satellite System device (Trimble GNSS). The locations of the test wells and observation well are indicated on Figure 1.

2.1 Water Quantity

Pumping tests were conducted in TWI, TWIII, TWIV, and TWV. On the day of the pumping tests, a submersible pump was installed approximately 1 metre above the bottom of the wells. Water levels were measured using a Solinst levelogger installed in the test wells, measuring water levels at 5 minute intervals for the duration of the pumping tests and for approximately 24 hours after completion of the tests. The drawdown in the test wells was also manually monitored during the tests to confirm water levels.

Water was pumped from the test wells at a rate of approximately 18.9 litres per minute for the duration of the pumping tests.

2.2 Groundwater Quality

The test wells were shock chlorinated prior to each of the pumping tests. Upon initiation of the pumping test, free chlorine was monitored in the water. A water sample was collected from the test wells approximately one hour after the start of pumping test, once monitoring indicated that the discharge water was free of chlorine. A subsequent sample was collected during the final hour of the pumping tests in accordance with the D-5-5 guideline.

A second pumping and sampling event was conducted on February 22, 2023 to resample wells for bacteria. The test wells were shocked and upon initiation of the pumping free chlorine was monitored in the water. A sample was collected after monitoring indicated that the discharge water was free of chlorine.

The samples were collected into laboratory-prepared bottles and submitted to Caduceon Environmental Laboratories (Caduceon). The pumping test samples were analyzed for a typical subdivision suite of analyses. During the subsequent pumping and sampling event the samples were analyzed for Escherichia Coli (E. Coli) and Total Coliforms.

2.3 Well Interference

The potential for well interference was assessed during the pumping tests by monitoring the drawdown at the other test wells and at the observation well (#A100275). Levelloggers were installed in these wells and configured to record water levels at 5 minute intervals prior to the pumping tests and until approximately 24 hours after the pumping tests.

3.0 Results and Discussion

3.1 Water Quantity

A summary of the well information and results of the pumping test are included in Table 1 (enclosed). Results from the manual measurements and levellogger data recording the drawdown of the wells during the pumping tests are enclosed as Figure 2a to 2d. Based on the proposed development of a single residential dwelling per proposed lot, comprising 4 bedrooms for a total of 5 people, and assuming per-person water demand of 450 litres per day, we calculated an anticipated daily water demand of 2,250 litres. Approximately 6,800 litres of water was pumped from the test wells over a period of 6 hours each. This is approximately 3 times the peak daily water demand calculated for the proposed lots should the lots be fully occupied. Environment Canada³ reports that average daily demand per person is approximately 274 litres per day. The volume pumped during each test was approximately 5 times the average daily demand for a house occupied by 5 people.

The static water levels and maximum observed drawdown in the test wells are provided in Table 1 (attached). A summary of observations is provided below:

- The first pumping test was conducted on TWI on July 11, 2022. A maximum drawdown of approximately 6.1 m (to a depth of approximately 14.6 metres below the top of the well casing (mbTOC) was observed and approximately 24.4 meters of water remained in the well at the completion of the pumping test. TWI returned to 95% of the initial water level, within approximately 4 hours and 55 minutes after the completion of the pumping test.
- The second pumping test was conducted on TWIV on July 12, 2022. A maximum drawdown of approximately 0.5 m (to a depth of approximately 7.4 mbTOC) was observed and approximately 23.9 meters of water remained in the well at the completion of the pumping test. TWIV returned to 95% of the initial water level, within approximately 2 hours after the completion of the pumping test.
- The third pumping test was conducted on TWV on July 21, 2022. A maximum drawdown of approximately 3.2 m (to a depth of approximately 8.6 mbTOC) was observed and approximately 41.1 meters of water remained in the well at the completion of the pumping test. TWV returned to 95% of the initial water level, within approximately 9 hours and 53 minutes after the completion of the pumping test.

³ Environment Canada. 2011. Municipal Water Use, 2009 Statistics. Ottawa <https://www.canada.ca/en/environment-climate-change/services/environmental-indicators/residential-water-use.html>

- The fourth pumping test was conducted on TWIII on July 26, 2022. A maximum drawdown of approximately 5.6 m (to a depth of approximately 10.1 mbTOC) was observed and approximately 26.8 meters of water remained in the well at the completion of the pumping test. TWV returned to 95% of the initial water level, within approximately 10 minutes after the completion of the pumping test.

During the 6-hour pumping tests conducted at TWI, TWIII, TWIV, and TWV, level loggers were utilized to monitor the water levels in the test wells and the observation well (#A100275) located at Fox Run by the River Retirement Residence. Water level data collected from the observation well (#A100275) between July 8 and 28, 2022 indicates a trend of approximately 2 meters of drawdown per day followed by recovery over approximately 8 hours. The observed drawdown in this well seems to be associated with the water usage by the occupants of Fox Run by the River Retirement Residence (refer to Figure 3 attached).

3.2 Water Quality Assessment

Results of the water quality analyses are summarized in Table 2 (enclosed) and are discussed briefly below. Laboratory certificates of analyses are enclosed.

Results from the sampling events generally met the ODWQS, objectives and guidelines, with the following exceptions:

- Turbidity was reported above the ODWS aesthetic objective in the samples collected from TWV during the first and last hour of pumping and from TWIII during the first hour of pumping.
- Hardness was reported above the ODWS operational guideline in the samples collected from TWI, TWIV, TWV, and TWIII during the first and last hour of pumping.
- Iron and manganese were reported above the ODWS aesthetic objectives in the samples collected from TWV during the first and last hour of pumping and from TWIII during the first hour of pumping.
- Sodium was reported above the ODWS aesthetic objectives in the samples collected from TWIV, TWV, TIII during the first and last hour of pumping and from TWI during the last hour of pumping.
- The presence of Total Coliform was reported in the samples collected during the first and last hour from TWIII and TWIV on July 26, 2022 and July 21, 2022 respectively. Test wells TWIII and TWIV were resampled On February 22, 2023 to further evaluate the Total Coliforms detections. The resampling results showed that E. Coli and Total Coliforms were not detected.

3.3 Well Interference

During the 6-hour pumping tests performed at TWI, TWIII, TWIV, and TWV, the water levels in the test wells and the observation well (#A100275) located at Fox Run by the River Retirement Residence were monitored through the use of level loggers. A Review of the data indicates that during the pumping tests only the pumping well exhibited drawdown related to pumping (see Figures 2a to 2d, attached).

Water level data collected from the observation well (#A100275) for the period of July 8 to 28, 2022 indicates a trend showing drawdown and recovery over an approximate 24-hour cycle. Observed drawdown in this well appears to be associated with water usage by the occupants of the Fox Run by the River Retirement Residence (see Figure 3, attached). Pumping tests conducted at the four test wells does not appear to contribute to the drawdown observed at the off-site observation well.

In our opinion, the recorded water level data indicates that the proposed water takings evaluated would not significantly interfere with the nearby monitored water wells considering the following:

- During the pumping tests the water levels in TWI, TWIII TWIV and TWV had a maximum drawdown of 0.5 to 6.1 m (to a depth of approximately 7.4 to 14.6 mBTOP) with approximately 80.0 to 97.9 % water column remaining at the end of the pumping tests. During these pumping tests approximately 3 times the peak daily water demand calculated for each proposed lot was pumped from the test wells.
- The test wells returned to 95% their initial water levels, within a period ranging from approximately 10 minutes to 9 hours and 53 minutes after the completion of the pumping tests.

4.0 Conclusions and Recommendations

Based on the findings of this study, these wells appear to have an adequate yield and water quality to support the proposed subdivision development, including 4 bedroom with 5 occupant residential dwellings, with an anticipated total peak daily water demand of 2,250 litres per day per lot. In our opinion the data further indicates that the water takings evaluated would not have an adverse impact on the nearby monitored water well located at the Fox Run by the River Retirement Residence. Due to the distance between the test wells, the effects of the radius of influence are unclear however significant impacts are not anticipated based on this study.

The findings of this Hydrogeological Evaluation Update are in general agreement with the conclusions presented in the Oliver, Mangione, McCalla and Associates Limited report entitled "Regina Residential Subdivision Hydrogeological and Terrain Analysis Report" Part of Lots 19 and 20, Concession 1 in the Township of Front of Leeds and

Lansdowne, dated February 1991. The current plan is a reduction from the previously proposed 26 lots down to the current proposed 25 lots. Additional recommendations for consideration are provided below:

- Concentrations of hardness exceeded the recommended ODWQS operational levels. Turbidity, and concentrations of iron and manganese, exceeded the aesthetic objectives. It is recommended that a water treatment specialist be consulted regarding the water quality and as a general best practice in maintaining a safe drinking water supply at the subject site.
- The presence of Total Coliform was reported in the samples collected during the first and last hour from TWIII and TWIV on July 26, 2022 and July 21, 2022 respectively. Test wells TWIII and TWIV were resampled On February 22, 2023 to further evaluate the Total Coliforms detections. The resampling results showed that E. Coli and Total Coliforms were not detected. Malroz recommends that drinking wells be equipped with an appropriate pre-filter and ultraviolet (UV) unit (or similar equipment) as a precautionary measure.
- Concentrations of nitrate should be considered as a part of the terrain and D-5-4 analyses.
- Concentrations of sodium exceeded the ODWS warning level but not the aesthetic objective. The ODQWS recommends that elevated sodium concentrations (above 20 mg/L) be reported to the local Medical Officer of Health (MOH). As a result, Malroz provided the attached letter to the Leeds and Grenville MOH on February 28, 2023. In addition, we recommend that a warning indicating elevated levels of sodium be included in future agreements of purchase and sale for the property.

In our opinion this investigation provides a reasonable characterization of the lands considered as part of the proposed development. It is also our opinion that this report satisfies conditions 23 and 24 as noted above, except the portions relating to the terrain and D-5-4 analyses which we understand is being conducted by others.

5.0 Closure


The findings reported in this document are based on the tasks completed by Malroz under the mutually agreed scope of work. Professional judgement, experience with similar investigations, and available data collected within the scope of work, form the basis for this letter. Malroz has prepared this letter using information understood to be factual and correct, and shall not be responsible for conditions arising from information or facts that were inaccurate, concealed, or not fully disclosed at the time of investigation.

This document has been prepared by Malroz for the sole use of FOTENN Planning + Design, in assessing the hydrogeological conditions at the proposed residential development in Leeds and the Thousand Islands, Ontario. Unauthorized reuse of this document for any other purpose, or by third parties, without the express written consent of Malroz, shall be at such party's sole risk without liability to Malroz. Malroz accepts no responsibility for damages, if any, suffered by any third party as a result of decisions or actions taken based on this report.

Please contact us if you have any questions, comments, or concerns with respect to this document or the appended data.

Yours truly,

Malroz Engineering Inc. (Malroz)

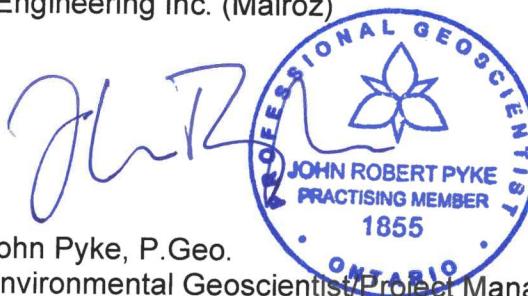

per: John Pyke, P.Geo.
Environmental Geoscientist/Project Manager

encl.:

Thousand Island Parkway Subdivision – Draft Plan of Proposed Subdivision

Figure 1: Site Plan

Figure 2a to 2d: Pumping Test Water Levels

Figure 3: Observation Well Water Levels

Table 1: Pumping Test Summary

Table 2: Groundwater Analytical Results

Laboratory Certificates of Analyses

Test Well WWRs

Letter to Medical Officer of Health

DRAFT PLAN of PROPOSED SUBDIVISION

PART OF LOTS 19 & 20, CONCESSION 1


Geographic Township of Leeds

TOWNSHIP OF LEEDS AND THE THOUSAND ISLANDS

COUNTY of LEEDS

SCALE = 1:1500

0 40 80 m H=1:1500

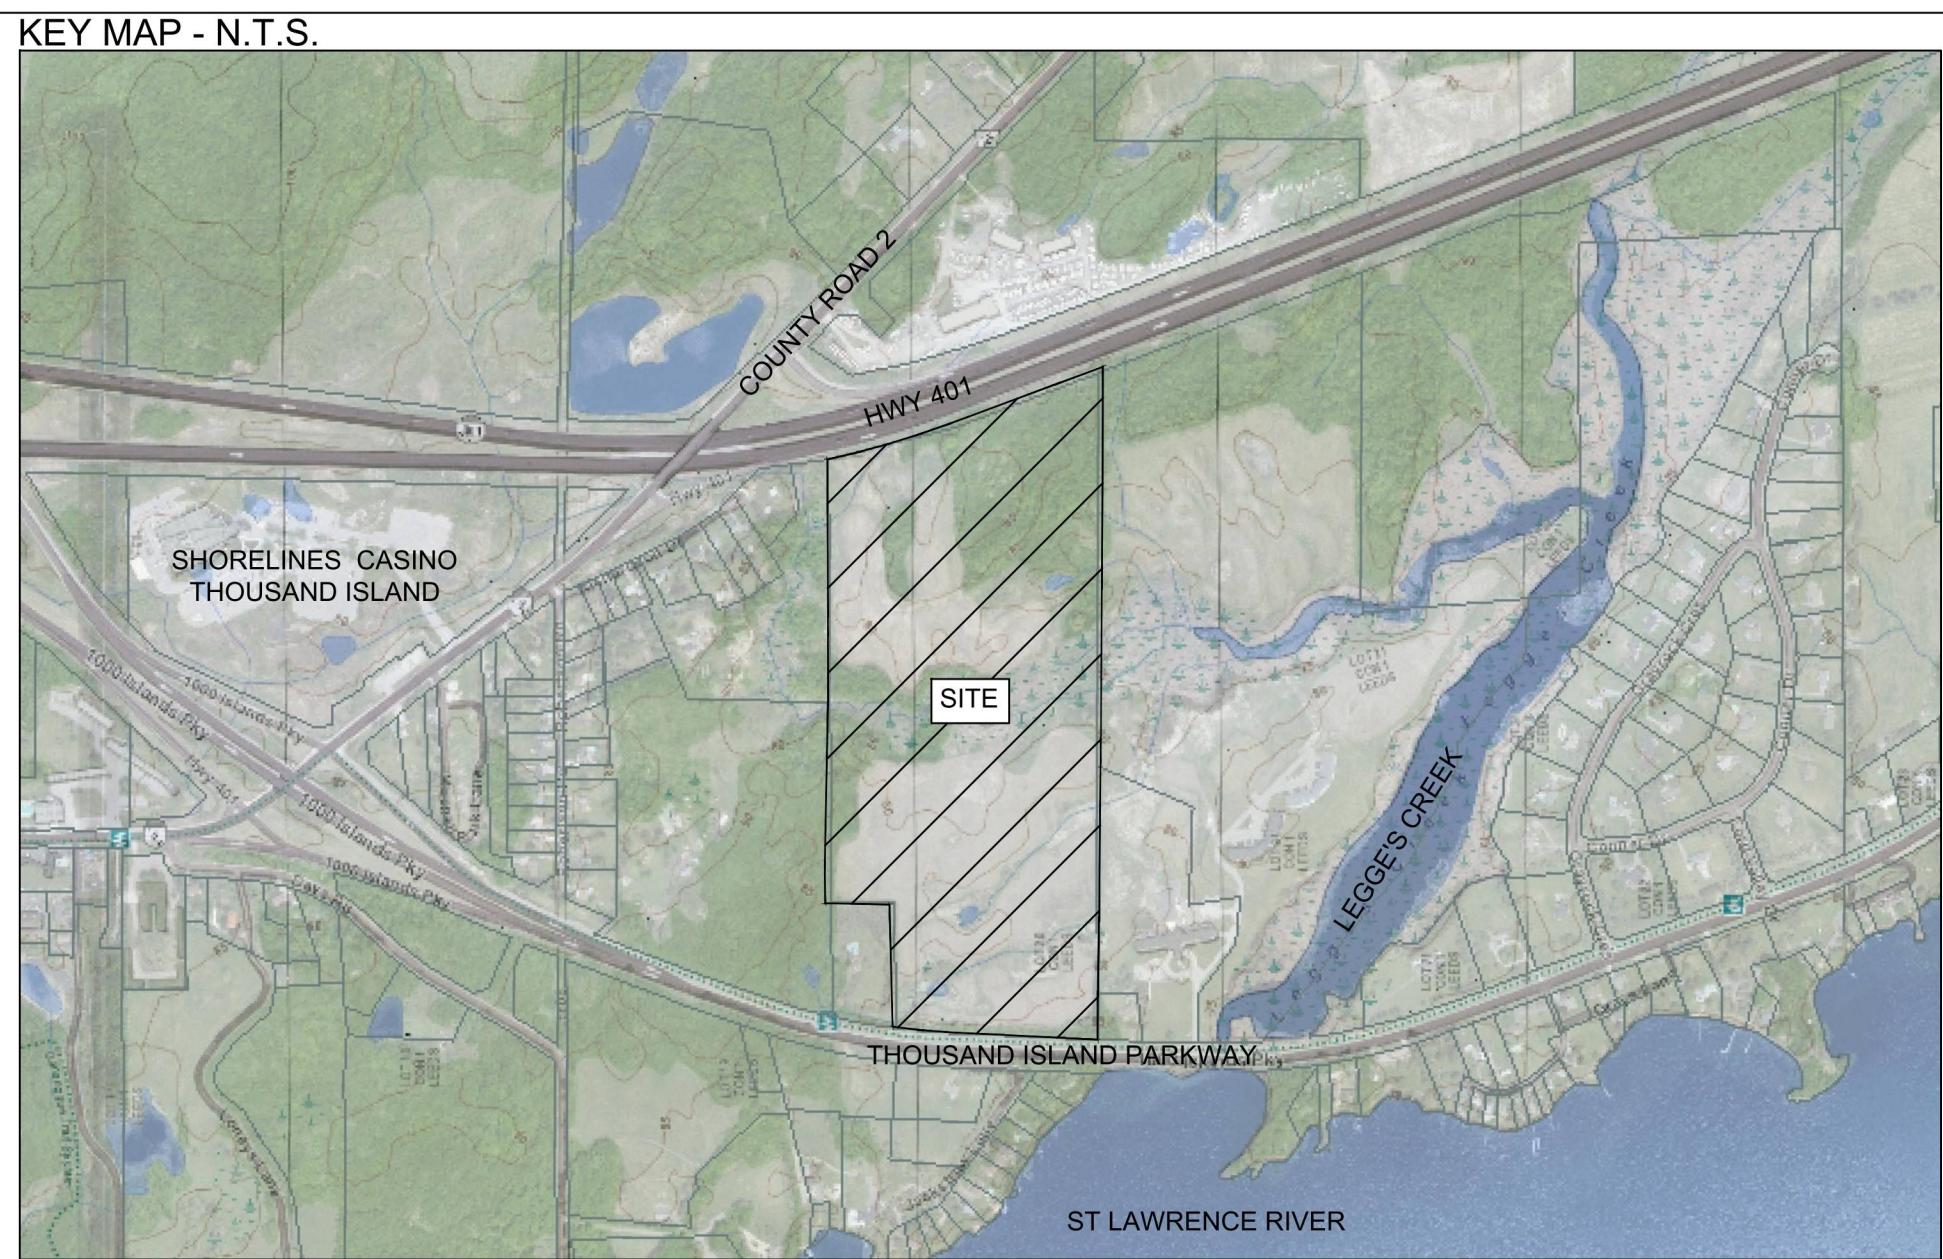

FOREFRONT Engineering Inc.
1329 Gardiners Road, Suite 210, Kingston, Ontario, Canada, K7P 0L8
T613.634.9009 F888.884.9392

ADDITIONAL INFORMATION REQUIRED UNDER SECTION 51.17(A-L) OF THE PLANNING ACT

- a: Shown on Draft Plan
- b: Shown on Draft Plan
- c: All Lands Owned, or In Which the Applicant Have an Interest Are Shown on the Key Plan.
- d: Residential
- e: Shown On Draft Plan
- f: Shown On Draft Plan
- g: Shown On Draft Plan
- h: Well Supplied
- i: Napanee Clay, and Rockland
- j: Shown On Draft Plan
- k: Road Maintenance, Garbage Collection, Phone, Cable, and Hydro
- l: Shown on Draft Plan

OWNER'S CERTIFICATE

I, DAN GREENE, HEREBY AUTHORIZE FOREFRONT
TO PREPARE AND SUBMIT THIS PLAN FOR REVIEW
AND APPROVAL.

GREENE'S ELECTRIC, PLUMBING & HEATING LTD.

DAN GREENE.

DATE: _____

SURVEYOR'S CERTIFICATE


1. THE BOUNDARIES OF THE LANDS TO BE SUBDIVIDED
AND THE RELATIONSHIP TO THE ADJACENT LANDS
ARE CORRECTLY SHOWN.

HOPKINS CHITTY LAND SURVEYORS INC.

PHIL CHITTY - O.L.S.


DATE: _____

METRIC
DISTANCES SHOWN ON THIS PLAN ARE
IN METRES AND CAN BE CONVERTED TO
FEET BY DIVIDING BY 0.3048

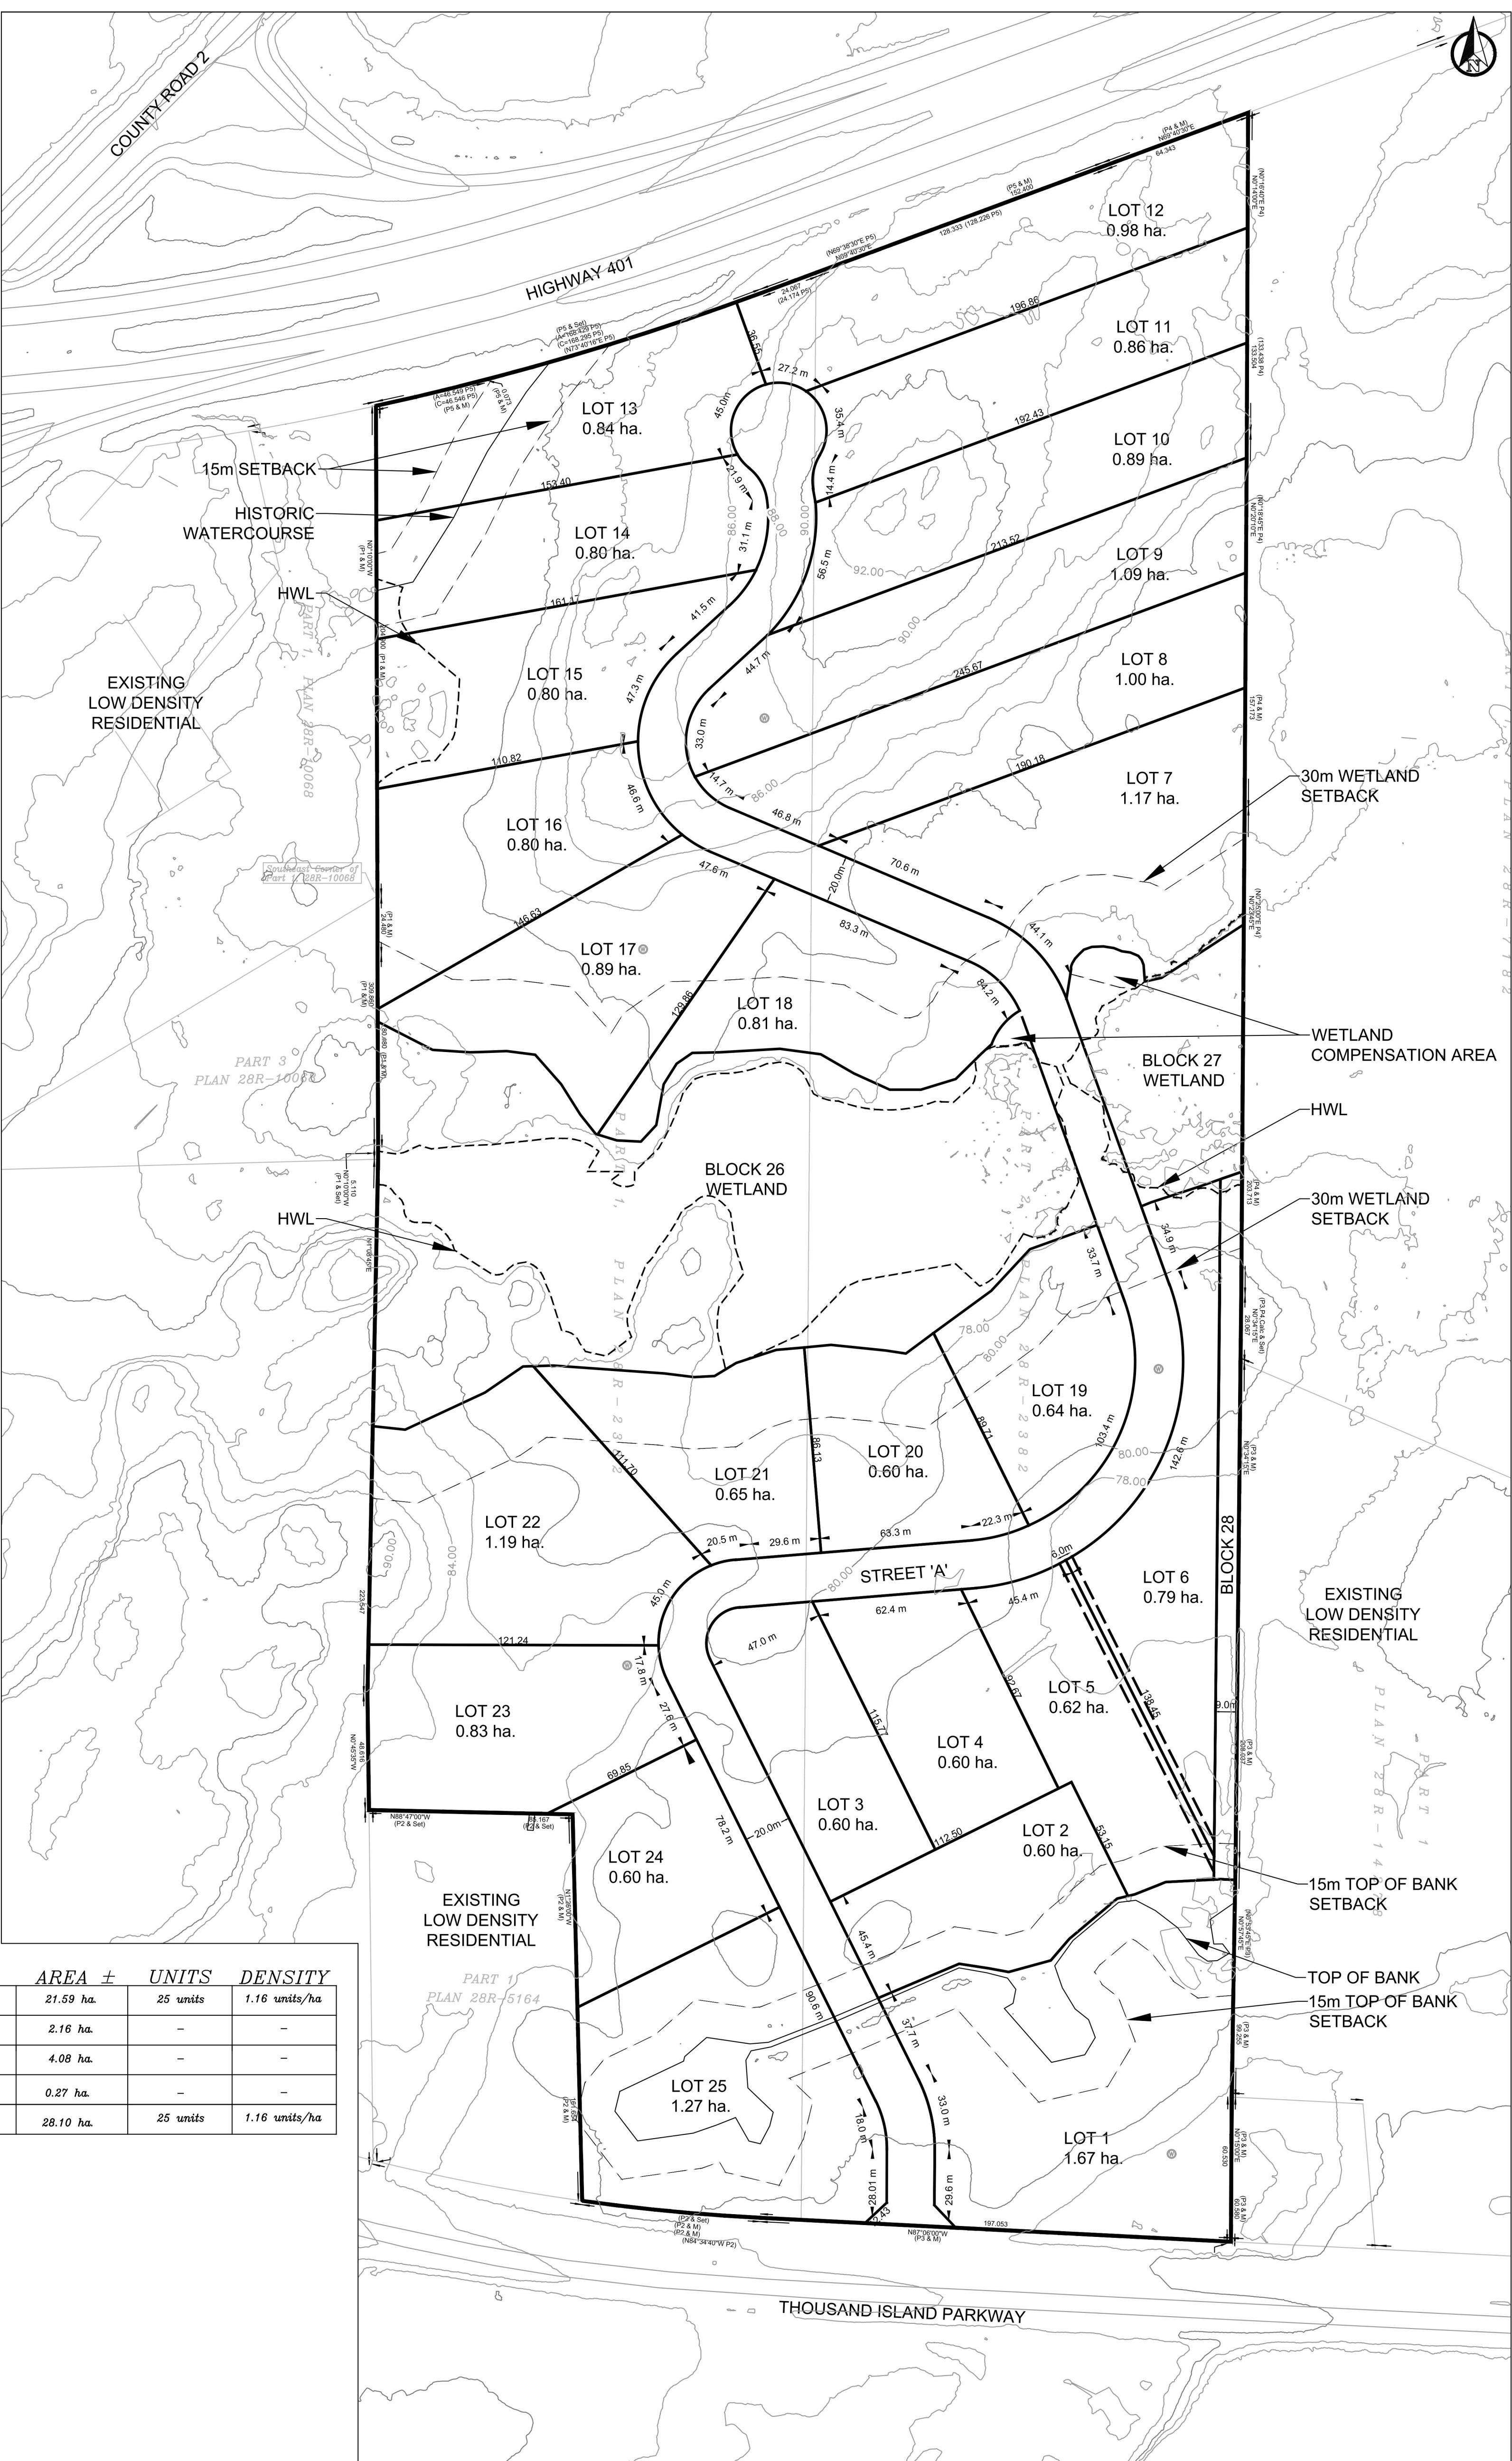

SITE DATA

LAND USE	LOTS & BLOCKS	AREA ±	UNITS	DENSITY
SINGLE DETACHED	LOTS 1-25	21.59 ha.	25 units	1.16 units/ha
STREETS/RESERVES	STREET 'A'	2.16 ha.	—	—
WETLAND	BLOCK 26, BLOCK 27	4.08 ha.	—	—
AREA COMPENSATION	BLOCK 28	0.27 ha.	—	—
TOTAL		28.10 ha.	25 units	1.16 units/ha

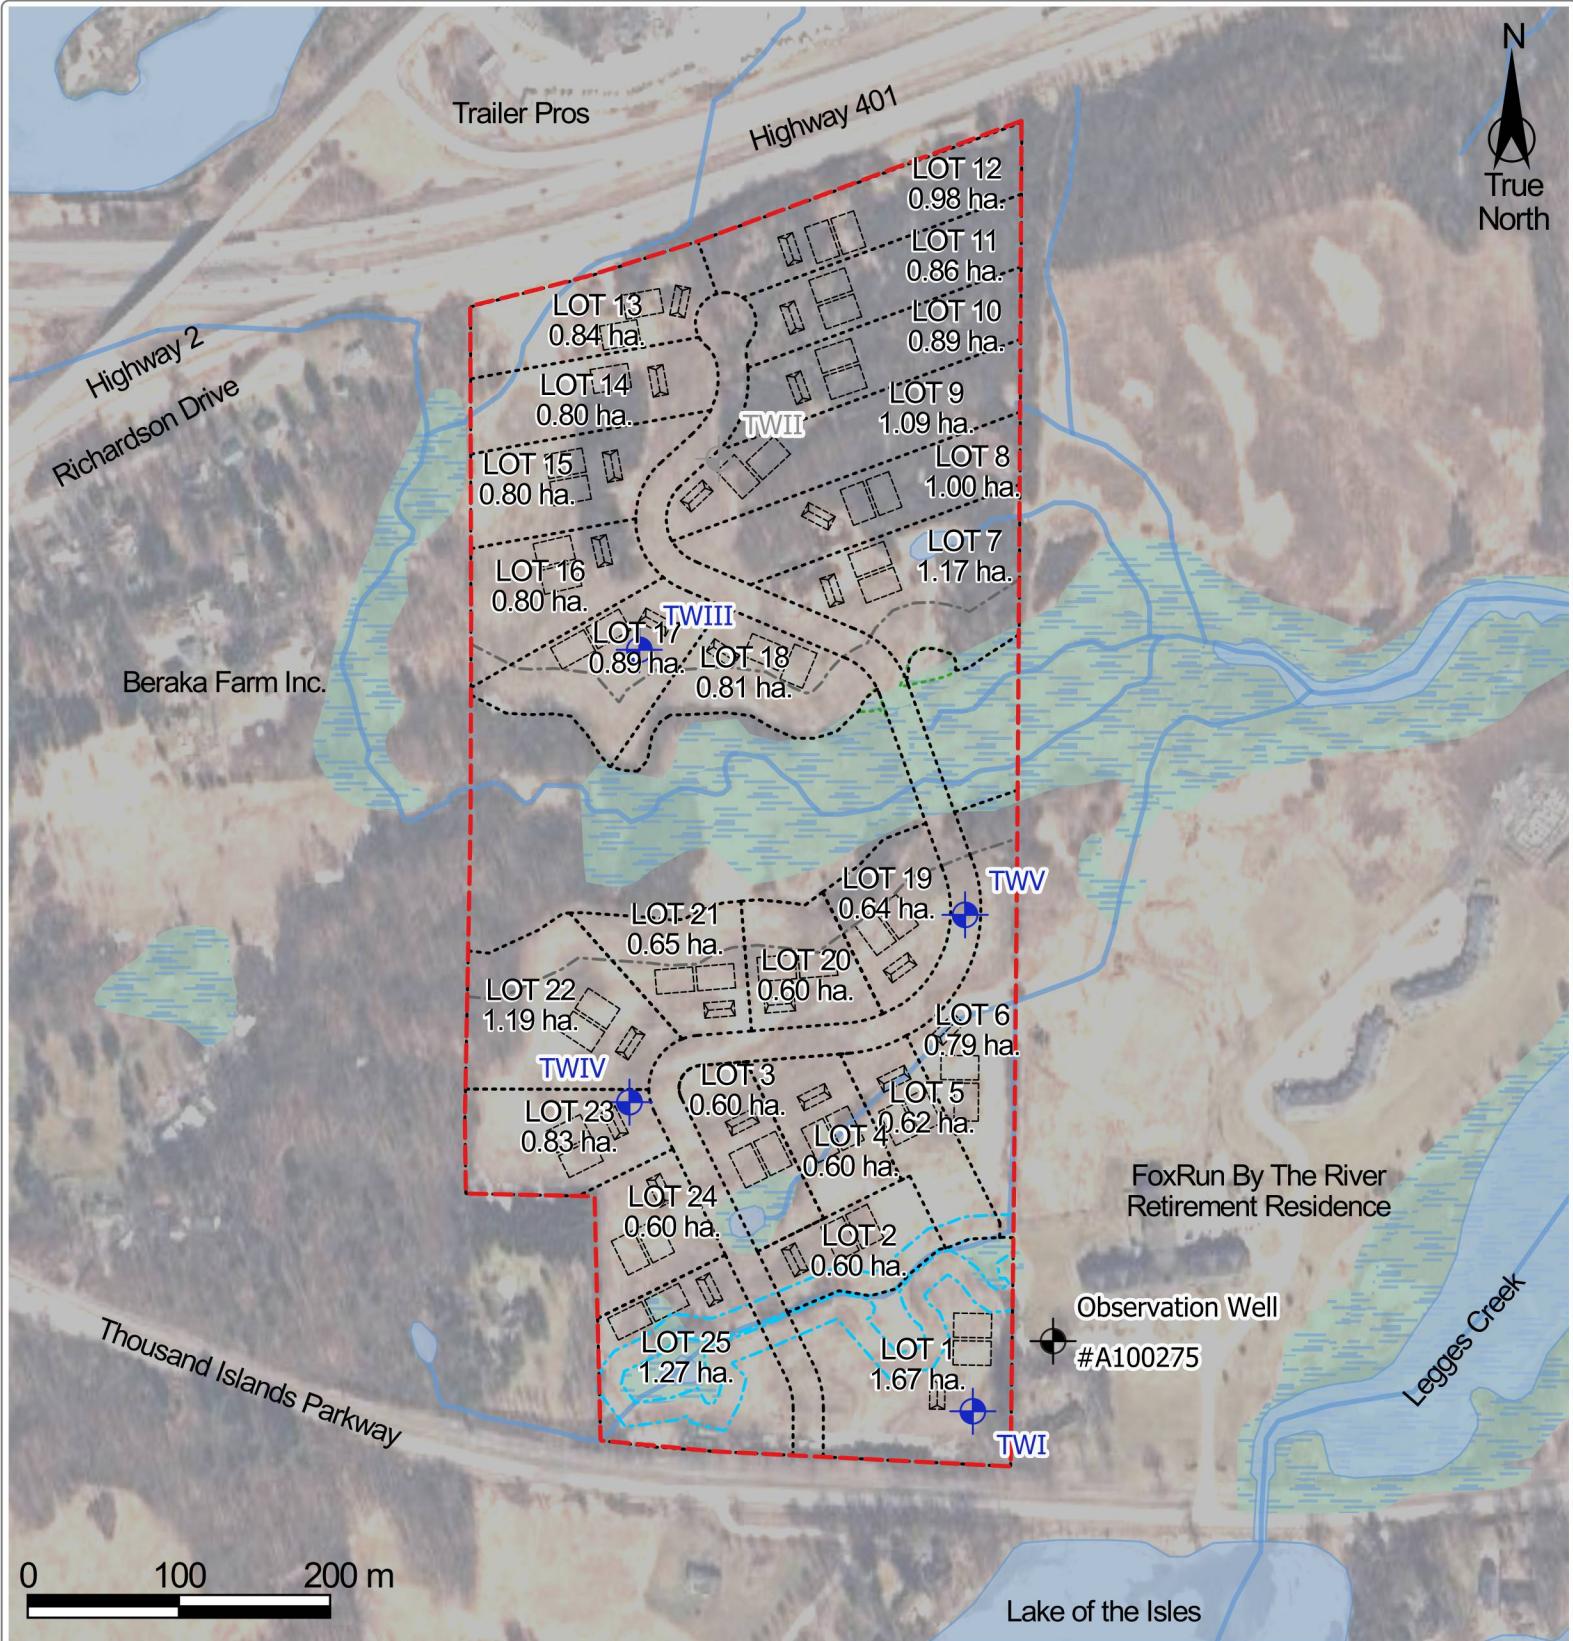


Legend

- approximate subject site boundary
- wetlands
- surface water body
- surface water course
- proposed lots with houses
- proposed drainage features
- proposed creek offsets
- proposed wetlands
- approximate location of test wells
- approximate location of observation well
- approximate location of damaged test well not included in testing program

Data Sources: Figure based on Google Earth imagery, Ontario Geohub Open Data and Regina Residential Subdivision Hydrogeology & Terrain Analysis Report Part Lots 19 & 20, Concession 1 Front of Leeds & Lansdowne Township by Oliver, Magione, McCalla & Associates Dated February 1991.

R0	2024-06-07	issued in final	ZL	JMP
Rev	Date	Description	By	Chkd
Site Plan				
Hydrogeological Evaluation Part of Lots 19 & 20 Concession 1, Leeds and the Thousand Islands, ON				
File: 1645.00-102		Figure 1		

Figure 2a
Pump Test TWI - Water Level vs Time

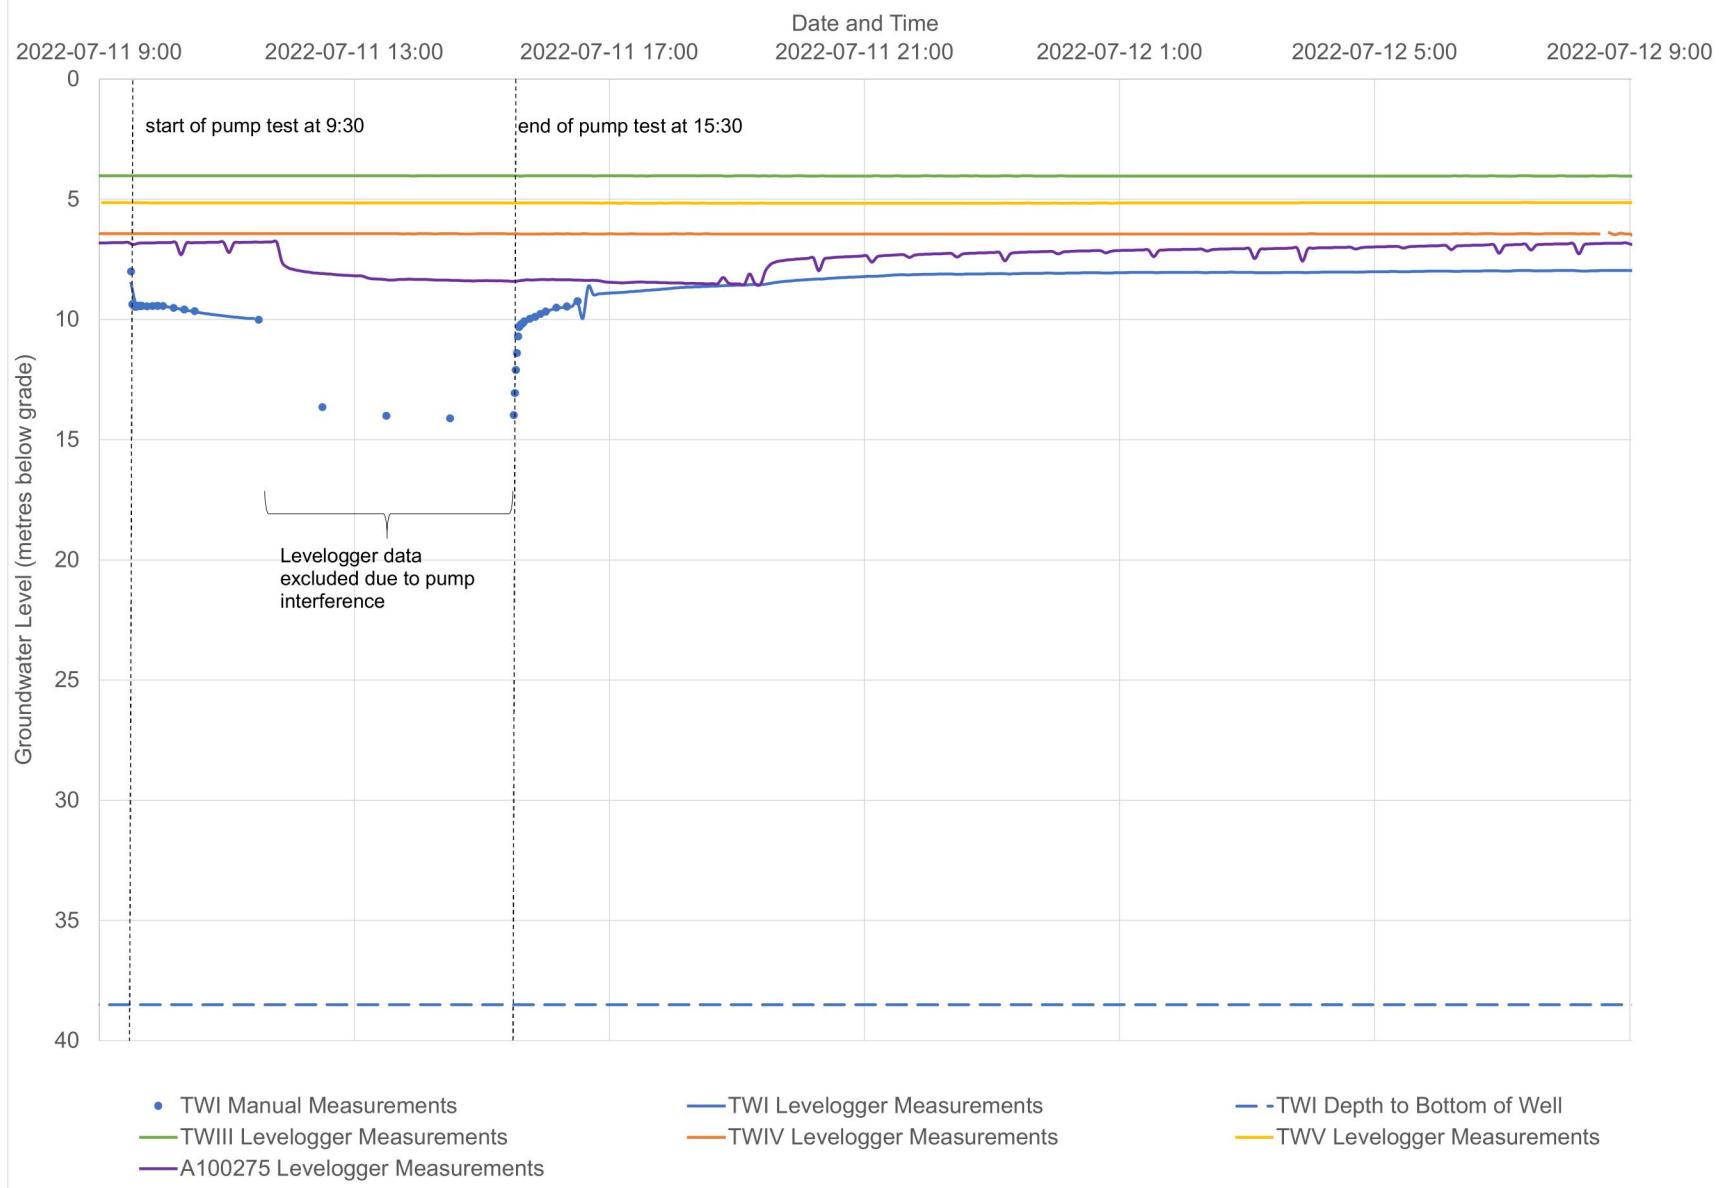

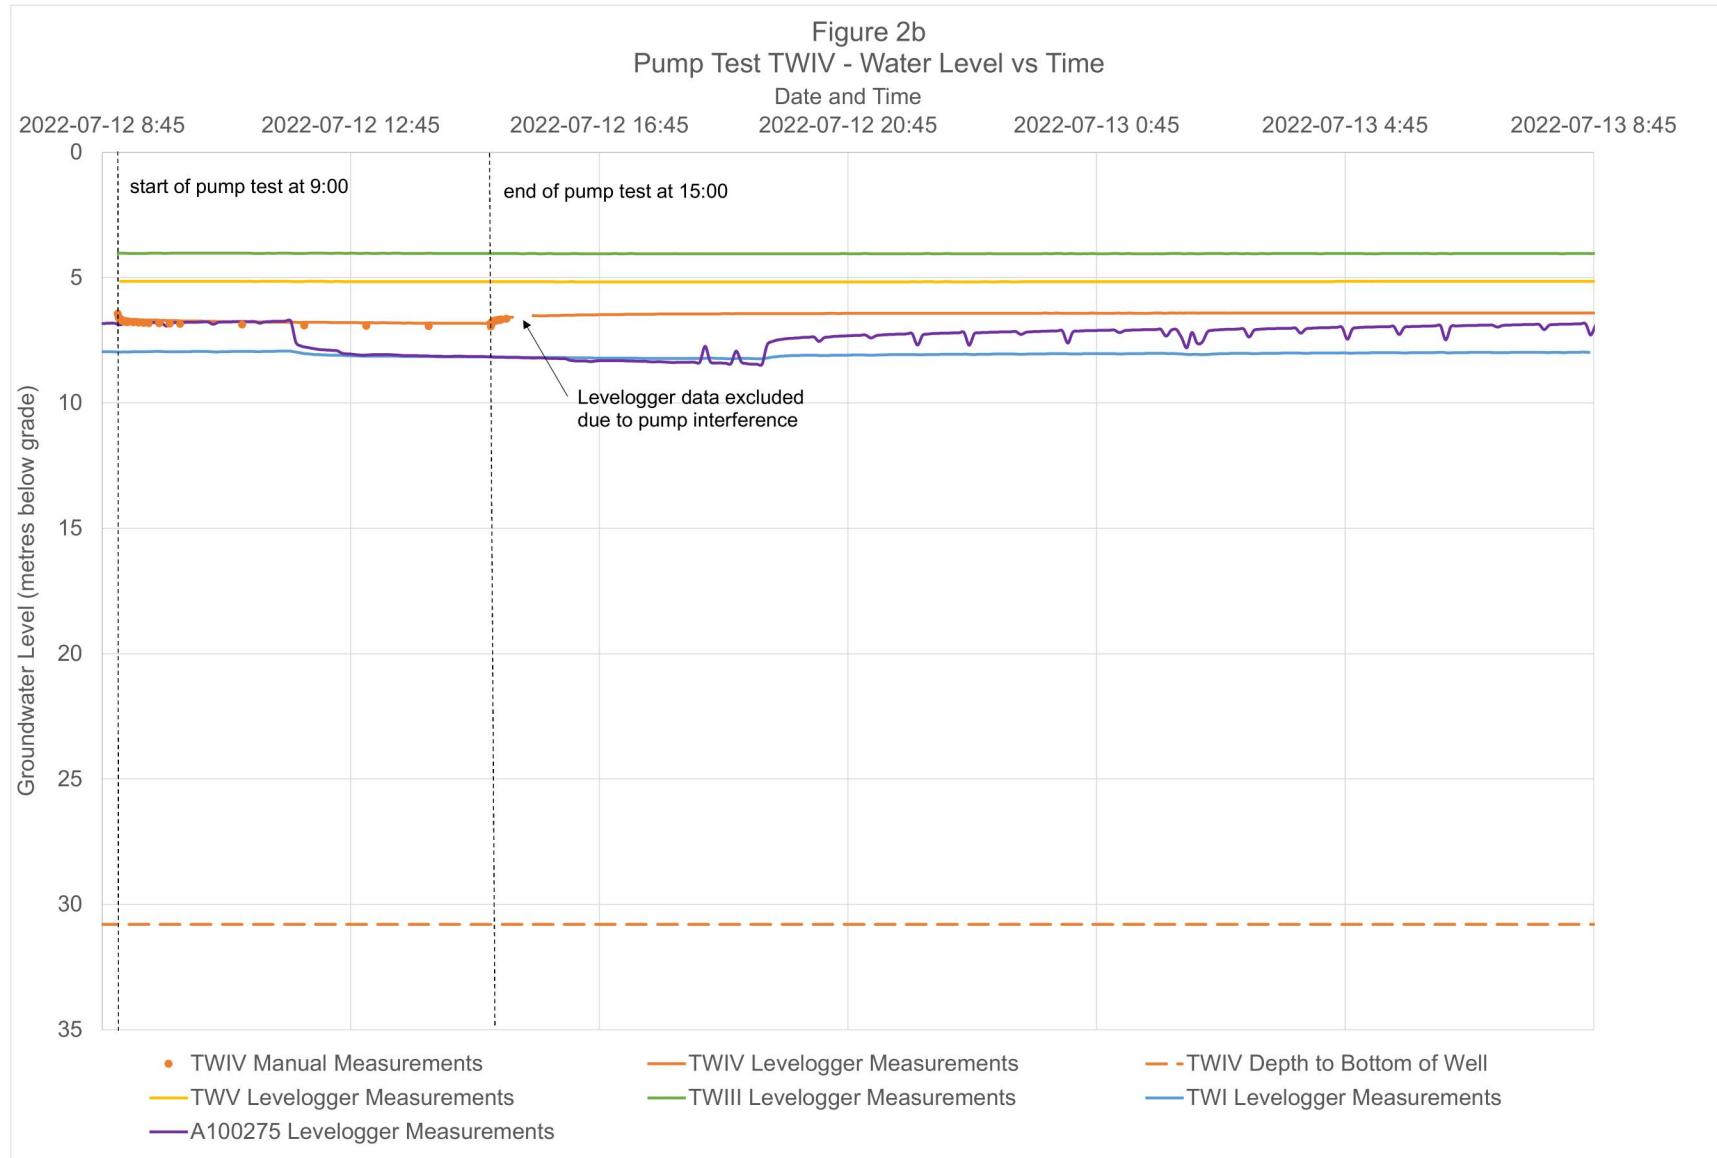


Figure 2c
Pump Test TWV - Water Level vs Time

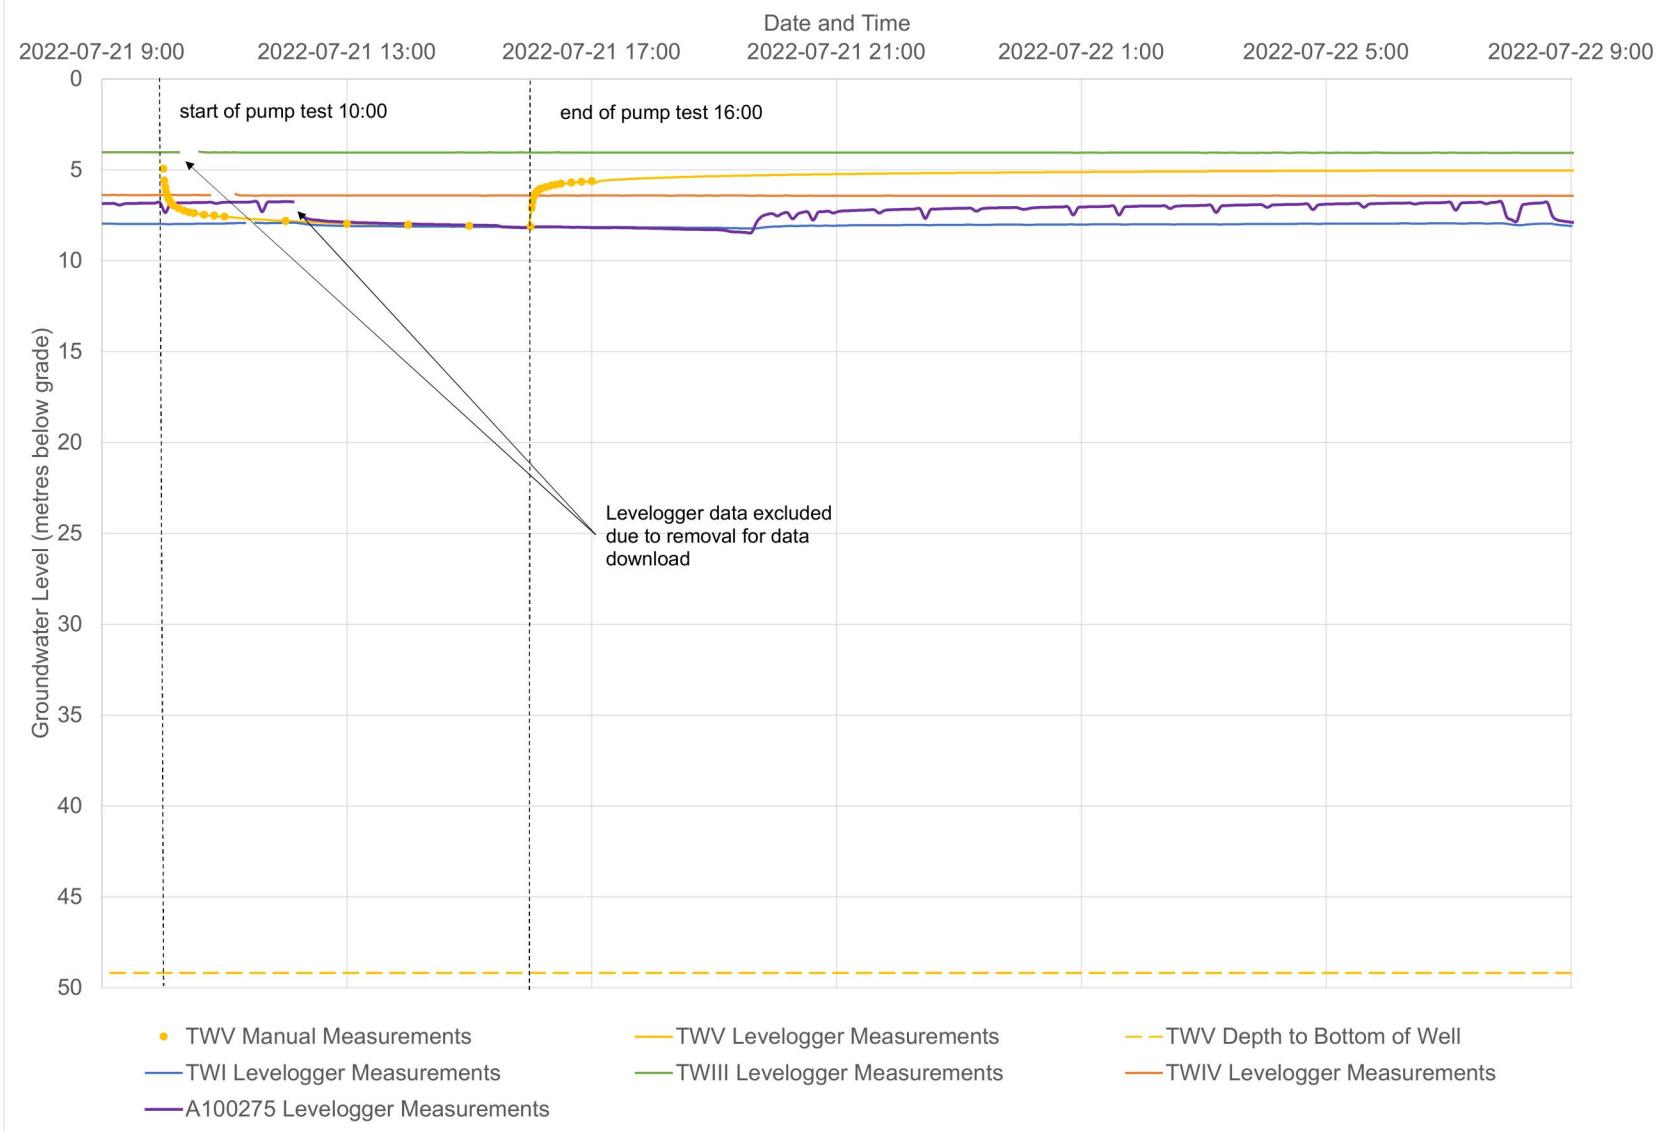


Figure 2d
Pump Test TWIII - Water Level vs Time

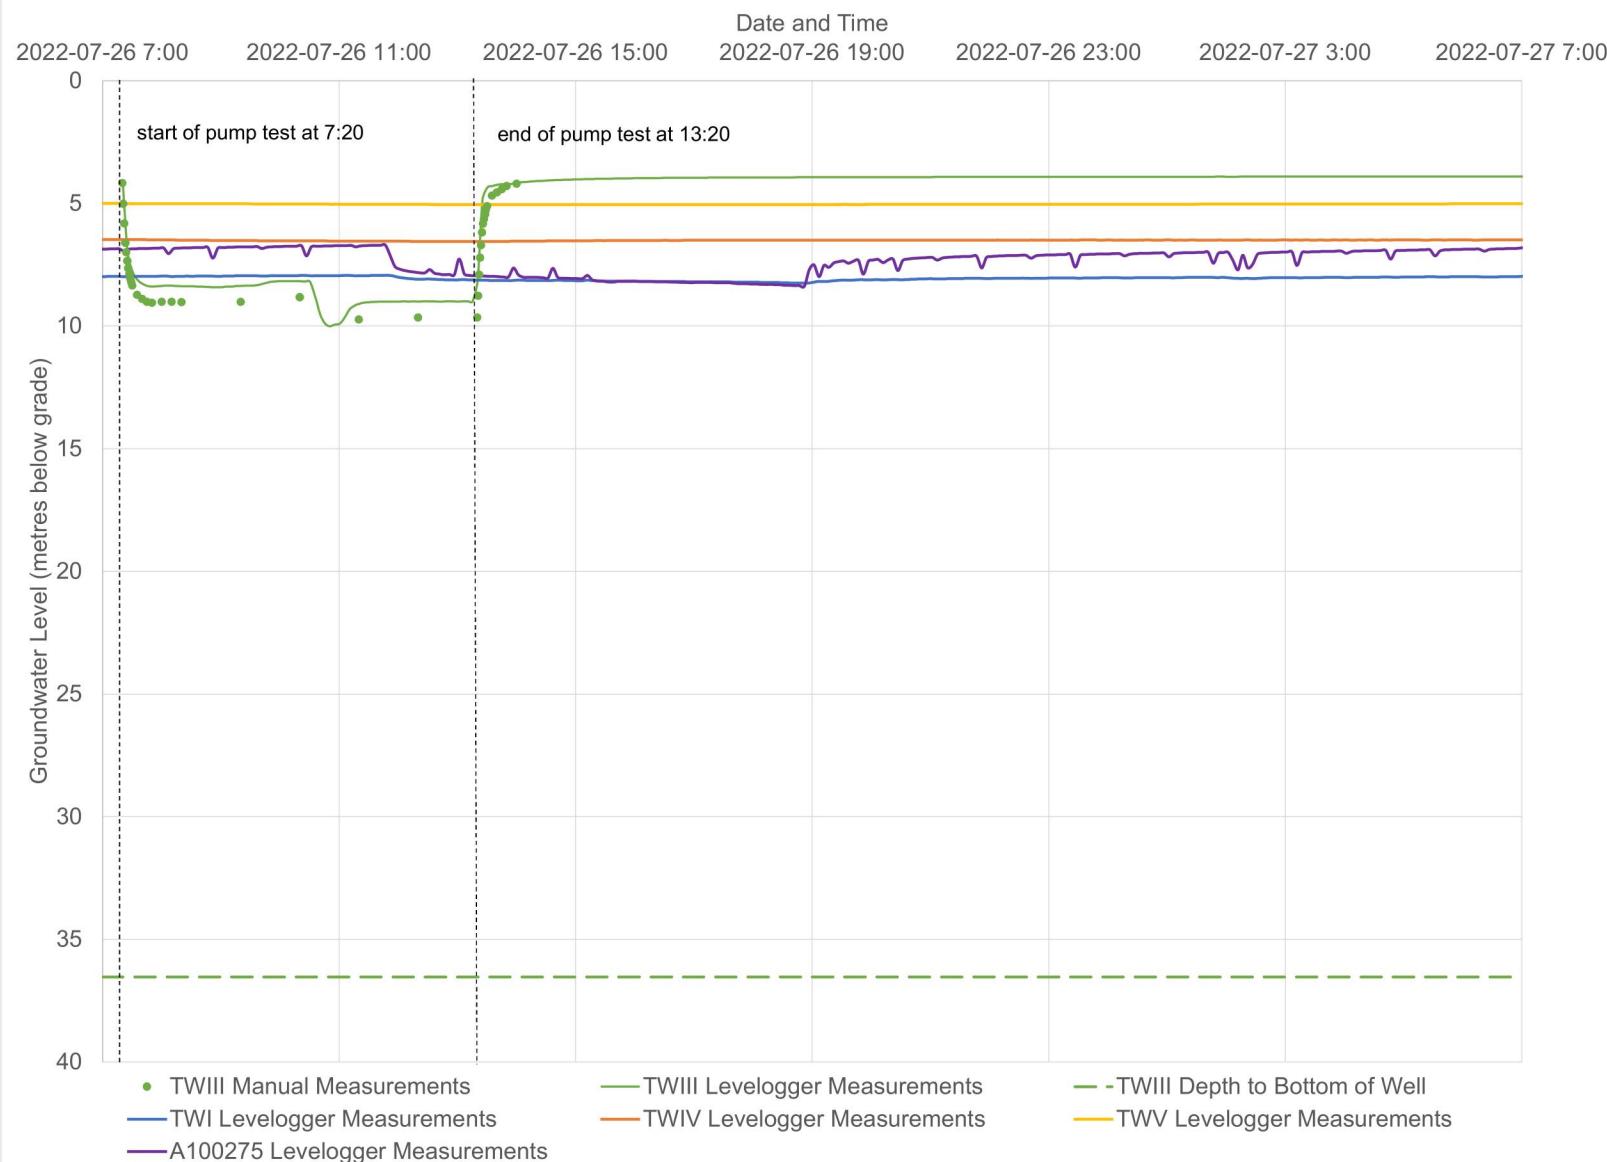


Figure 3
Observation Well (#A100275) - Water Level vs Time

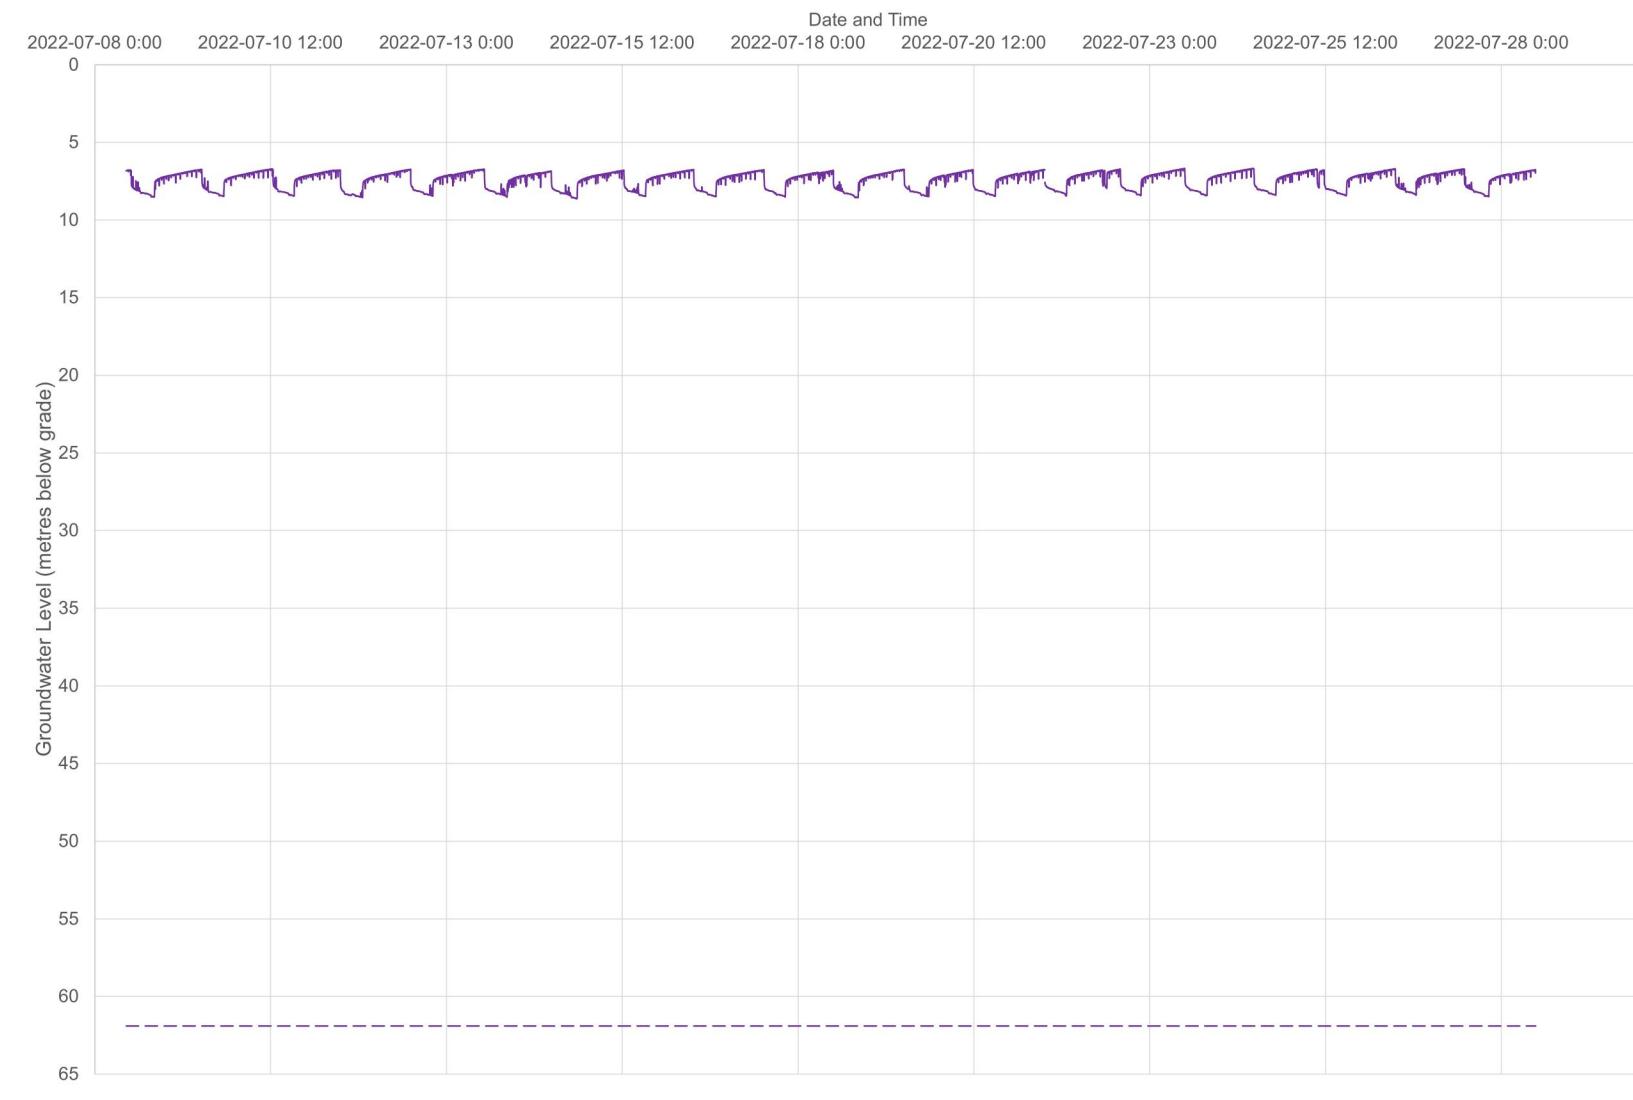


Table 1
Pumping Test Summary - Test Wells TWI, TWIII, TWIV, TWV

Location	Subject Site - Part of Lots 19 & 20 Concession 1, Leeds and the Thousand Islands			
	TWI	TWIV	TWV	TWIII
Date of Pump Test	July 11, 2022	July 12, 2022	July 21, 2022	July 26, 2022
Pumping Rate (litres/minute)	18.9	18.9	18.9	18.9
Depth of Well (mbTOC)	39.00	31.20	49.70	36.91
Static Water Level (mbTOC)	8.50	6.85	5.46	4.55
Available Drawdown (m)	30.50	24.35	44.24	32.36
Duration of Pumping (hours)	6	6	6	6
Calculated Volume Pumped From Well (litres)	6,800	6,800	6,800	6,800
Maximum Drawdown Observed (m)	6.11	0.50	3.18	5.57
Depth to Water during Maximum Drawdown (mbTOC)	14.61	7.35	8.64	10.12
Time to 95 % Recovery of Initial Pumping Water Level (mins)	295	120	593	10
Percentage of Water Column Drawdown During Pumping	20.0%	2.1%	7.2%	17.2%
Percentage of Static Water Column Remaining at the End of Pumping Test	80.0%	97.9%	92.8%	82.8%

Notes:

mbTOC

metres below top of well casing

 Data Input: JMP
 Data Check: RV

Table 2
Groundwater Analytical Results

Parameter	Location:		TWI			TWIV			TWV			TWIII			ODWS		
	Date Collected:		2022-07-11		2022-07-12		2023-02-22		2022-07-21		2022-07-26		2023-02-22				
	Time Collected:		10:20	14:40	9:40	14:30	-	11:20	15:45	8:12	13:15	-	8:12	13:15	-		
	Client ID:		22-W001	22-W002	22-W003	22-W004	TWIV	22-W005	22-W006	22-W007	22-W008	TWIII	22-W007	22-W008	TWIII		
	Sample ID:		B22-21653-1	B22-21653-2	B22-21987-1	B22-21987-2	23-003060-1	B22-23223-1	B22-23223-1	B22-23655-1	B22-23655-1	23-003059-1	B22-23655-1	B22-23655-1	23-003059-1	Objective	Type of Objective
Parameter	Units	M.D.L.															
Total Coliform	cfu/100mL	1	0	0	NDOGT	22	0	0	0	NDOGT	NDOGT	0	0	0	0	MAC	MAC
E coli	cfu/100mL	1	0	0	NDOGT	3	0	0	0	NDOGT	NDOGT	0	0	0	0	MAC	MAC
Background	cfu/100mL	1	0	63	NDOGT	> 200	-	141	44	NDOGT	NDOGT	-	-	-	-		
Alkalinity(CaCO ₃) to pH4.5	mg/L	5	324	352	419	407	-	463	450	184	243	-	-	-	-	30-500	OG
pH @25°C	pH Units	N/A	7.88	7.89	8.19	8.1	-	8.16	8.15	8.1	8	-	-	-	-	6.5-8.5	OG
Conductivity @25°C	μmho/cm	1	676	1130	916	851	-	838	832	977	576	-	-	-	-		
Colour	TCU	2	<	<	<	<	-	<	<	<	<	-	-	-	-	5	AO
Turbidity	NTU	0.1	2.6	0.3	0.5	0.2	-	6.4	5.6	36.1	1.4	-	-	-	-	5	AO
Fluoride	mg/L	0.1	0.3	0.2	0.4	0.3	-	0.3	0.3	0.5	0.3	-	-	-	-	1.5	MAC
Chloride	mg/L	0.5	11.3	150	46.6	34.6	-	4.5	5.7	155	13.7	-	-	-	-	250	AO
Nitrate (N)	mg/L	0.1	6.9	3.7	3.5	2.6	-	<	<	<	2.2	-	-	-	-	10.0	MAC
Nitrite (N)	mg/L	0.1	<	<	<	<	-	<	<	<	<	-	-	-	-	1.0	MAC
Sulphate	mg/L	1	7	17	19	19	-	22	24	69	37	-	-	-	-	500	AO
Total Kjeldahl Nitrogen	mg/L	0.1	<	0.1	0.8	<	-	0.3	0.3	2.8	0.2	-	-	-	-		
Ammonia + Ammonium (N)	mg/L	0.01	<	<	0.83	0.02	-	0.16	0.15	2.24	0.05	-	-	-	-		
Organic Nitrogen (Calculation)	mg/L	0.1	<	0.1	<	<	-	0.1	0.1	0.5	0.1	-	-	-	-	0.15	OG
Tannins and Lignins	mg/L	0.5	<	<	<	<	-	<	<	<	1	-	-	-	-	5	AO
Dissolved Organic Carbon	mg/L	0.2	1.7	1.1	1.5	1.4	-	2.1	2	<	<	-	-	-	-		
Phenolics	mg/L	0.001	<	<	<	<	-	<	<	0.006	<	-	-	-	-		
Sulphide	mg/L	0.01	<	<	0.01	<	-	0.01	<	0.59	<	-	-	-	-	0.05	AO
Hardness (as CaCO ₃)	mg/L	1	364	453	466	448	-	440	426	181	269	-	-	-	-	500,80-100	ODWO,OG
Calcium	mg/L	0.02	76.2	98.5	72.4	74.5	-	72.1	70.9	55	78.5	-	-	-	-		
Copper	mg/L	0.002	0.004	<	<	<	-	<	<	<	<	-	-	-	-	1	AO
Iron	mg/L	0.005	0.083	0.005	0.099	0.027	-	0.674	0.691	1.54	0.152	-	-	-	-	0.3	AO
Magnesium	mg/L	0.02	42.2	50.3	69.3	63.8	-	63.1	60.6	10.6	17.6	-	-	-	-		
Manganese	mg/L	0.001	0.006	<	0.024	0.001	-	0.054	0.053	0.091	0.03	-	-	-	-	0.05	AO
Potassium	mg/L	0.1	1.2	1.6	2.1	1.8	-	2.4	2.4	1.8	1.6	-	-	-	-		
Sodium	mg/L	0.2	14.9	80	37.3	28.9	-	37.3	38.1	127	21.6	-	-	-	-	200,20	AO,WL
Zinc	mg/L	0.005	0.005	<	0.017	0.019	-	<	<	<	<	-	-	-	-	5	AO
Silicon	mg/L	0.01	9.53	9.15	10	9.33	-	16	16.1	13.6	9.33	-	-	-	-		
Silica	mg/L	0.02	20.4	19.6	21.4	20	-	34.2	34.4	29.2	20	-	-	-	-		

Data Input: CM
Data Check: AS

Notes: M.D.L. method detection limit

< result below M.D.L.

N/A not applicable

- not analyzed

indicates value exceeds Ontario Drinking Water Quality Standards

OG - Operational Guideline AO - Aesthetic Objective CS- Chemical Standard

NDOGT no data, sample overgrown with target bacteria

* The aesthetic objective for sodium is 200 mg/L, however, the local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diet

C.O.C.: DW120182

REPORT No. B22-21653

Report To:

Malroz Engineering Inc.
308 Wellington Street, 2nd Floor
Kingston ON K7K 7A8 Canada
Attention: Mallory Wright

DATE RECEIVED: 11-Jul-22

DATE REPORTED: 20-Jul-22

SAMPLE MATRIX: Drinking Water

Caduceon Environmental Laboratories

285 Dalton Ave
Kingston Ontario K7K 6Z1
Tel: 613-544-2001
Fax: 613-544-2770

JOB/PROJECT NO.: 1424

P.O. NUMBER:

WATERWORKS NO.

Parameter	Units	R.L.	Client I.D.:		22-W001	22-W002	ODWS	
			Sample I.D.:		B22-21653-1	B22-21653-2	Objective	Type of Objective
			Date Collected:		11-Jul-22	11-Jul-22		
Total Coliform	cfu/100mL	1	MOE E3407	12-Jul-22/K	0	0	0	MAC
E. coli	cfu/100mL	1	MOE E3407	12-Jul-22/K	0	0	0	MAC
Background	cfu/100mL	1	SM9222B	12-Jul-22/K	0	63		
Alkalinity(CaCO ₃) to pH4.5	mg/L	5	SM 2320B	12-Jul-22/O	324	352	30-500	OG
pH @25°C	pH Units		SM 4500H	12-Jul-22/O	7.88	7.89	6.5-8.5	OG
Conductivity @25°C	µmho/cm	1	SM 2510B	12-Jul-22/O	676	1130		
Colour	TCU	2	SM 2120C	14-Jul-22/O	< 2	< 2	5	AO
Turbidity	NTU	0.1	SM 2130	14-Jul-22/O	2.6	0.3	5	AO
Fluoride	mg/L	0.1	SM4110C	12-Jul-22/O	0.3	0.2	1.5	MAC
Chloride	mg/L	0.5	SM4110C	12-Jul-22/O	11.3	150	250	AO
Nitrate (N)	mg/L	0.1	SM4110C	12-Jul-22/O	6.9	3.7	10	MAC
Nitrite (N)	mg/L	0.1	SM4110C	12-Jul-22/O	< 0.1	< 0.1	1	MAC
Sulphate	mg/L	1	SM4110C	12-Jul-22/O	7	17	500	AO
Total Kjeldahl Nitrogen	mg/L	0.1	E3516.2	15-Jul-22/K	< 0.1	0.1		
Ammonia + Ammonium (N)	mg/L	0.01	SM4500-NH ₃ -H	13-Jul-22/K	< 0.01	< 0.01		
Organic Nitrogen (Calculation)	mg/L	0.1	E3516.2	19-Jul-22/K	< 0.1	0.1	0.15	OG
Tannins and Lignins	mg/L	0.5	SM5500B	12-Jul-22/K	< 0.5	< 0.5		
Dissolved Organic Carbon	mg/L	0.2	EPA 415.2	12-Jul-22/O	1.7	1.1	5	AO
Phenolics	mg/L	0.001	MOEE 3179	18-Jul-22/K	< 0.001	< 0.001		
Sulphide	mg/L	0.01	SM4500-S2	14-Jul-22/K	< 0.01	< 0.01	0.05	AO
Hardness (as CaCO ₃)	mg/L	1	SM 3120	13-Jul-22/O	364	453	500,80-100	ODWO,OG
Calcium	mg/L	0.02	SM 3120	13-Jul-22/O	76.2	98.5		
Copper	mg/L	0.002	SM 3120	13-Jul-22/O	0.004	< 0.002	1	AO
Iron	mg/L	0.005	SM 3120	13-Jul-22/O	0.083	0.005	0.3	AO
Magnesium	mg/L	0.02	SM 3120	13-Jul-22/O	42.2	50.3		

ODWS - Ontario Drinking Water Standards

AO - Aesthetic Objectives

IMAC - Interim Maximum Acceptable Concentration

MAC - Maximum Acceptable Concentration

ODWO - D-5-5 Objective

OG - Operational Guidelines

WL - Warning Level - Sodium Restricted Diets

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

Steve Garrett
Director of Laboratory Services

C.O.C.: DW120182

REPORT No. B22-21653

Report To:

Malroz Engineering Inc.
 308 Wellington Street, 2nd Floor
 Kingston ON K7K 7A8 Canada
Attention: Mallory Wright

Caduceon Environmental Laboratories

285 Dalton Ave
 Kingston Ontario K7K 6Z1
 Tel: 613-544-2001
 Fax: 613-544-2770

DATE RECEIVED: 11-Jul-22

JOB/PROJECT NO.: 1424

DATE REPORTED: 20-Jul-22

P.O. NUMBER:

SAMPLE MATRIX: Drinking Water

WATERWORKS NO.

			Client I.D.:	22-W001	22-W002	ODWS	
			Sample I.D.:	B22-21653-1	B22-21653-2	Objective	Type of Objective
			Date Collected:	11-Jul-22	11-Jul-22		
Parameter	Units	R.L.	Reference Method	Date/Site Analyzed			
Manganese	mg/L	0.001	SM 3120	13-Jul-22/O	0.006	< 0.001	0.05 AO
Potassium	mg/L	0.1	SM 3120	13-Jul-22/O	1.2	1.6	
Sodium	mg/L	0.2	SM 3120	13-Jul-22/O	14.9	80.0	200,20 AO,WL
Zinc	mg/L	0.005	SM 3120	13-Jul-22/O	0.005	< 0.005	5 AO
Silicon	mg/L	0.01	SM 3120	13-Jul-22/O	9.53	9.15	
Silica	mg/L	0.02	SM 3120	13-Jul-22/O	20.4	19.6	

ODWS - Ontario Drinking Water Standards

AO - Aesthetic Objectives

IMAC - Interim Maximum Acceptable Concentration

MAC - Maximum Acceptable Concentration

ODWO - D-5-5 Objective

OG - Operational Guidelines

WL - Warning Level - Sodium Restricted Diets

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

Steve Garrett
 Director of Laboratory Services

C.O.C.: DW120181

REPORT No. B22-21987

Report To:

Malroz Engineering Inc.
308 Wellington Street, 2nd Floor
Kingston ON K7K 7A8 Canada
Attention: Jessie Payeur

DATE RECEIVED: 12-Jul-22

DATE REPORTED: 20-Jul-22

SAMPLE MATRIX: Drinking Water

Caduceon Environmental Laboratories

285 Dalton Ave
Kingston Ontario K7K 6Z1
Tel: 613-544-2001
Fax: 613-544-2770

JOB/PROJECT NO.: 1645

P.O. NUMBER:

WATERWORKS NO.

Parameter	Units	R.L.	Client I.D.:		22-W003	22-W004	ODWS	
			Sample I.D.:		B22-21987-1	B22-21987-2	Objective	Type of Objective
			Date Collected:		12-Jul-22	12-Jul-22		
Total Coliform	cfu/100mL	1	MOE E3407	13-Jul-22/K	NDOGT	22	0	MAC
E. coli	cfu/100mL	1	MOE E3407	13-Jul-22/K	NDOGT	3	0	MAC
Background	cfu/100mL	1	SM9222B	13-Jul-22/K	NDOGT	> 200		
Alkalinity(CaCO ₃) to pH4.5	mg/L	5	SM 2320B	13-Jul-22/O	419	407	30-500	OG
pH @25°C	pH Units		SM 4500H	13-Jul-22/O	8.19	8.10	6.5-8.5	OG
Conductivity @25°C	µmho/cm	1	SM 2510B	13-Jul-22/O	916	851		
Colour	TCU	2	SM 2120C	14-Jul-22/O	< 2	< 2	5	AO
Turbidity	NTU	0.1	SM 2130	14-Jul-22/O	0.5	0.2	5	AO
Fluoride	mg/L	0.1	SM4110C	13-Jul-22/O	0.4	0.3	1.5	MAC
Chloride	mg/L	0.5	SM4110C	13-Jul-22/O	46.6	34.6	250	AO
Nitrate (N)	mg/L	0.1	SM4110C	13-Jul-22/O	3.5	2.6	10	MAC
Nitrite (N)	mg/L	0.1	SM4110C	13-Jul-22/O	< 0.1	< 0.1	1	MAC
Sulphate	mg/L	1	SM4110C	13-Jul-22/O	19	19	500	AO
Total Kjeldahl Nitrogen	mg/L	0.1	E3516.2	15-Jul-22/K	0.8	< 0.1		
Ammonia + Ammonium (N)	mg/L	0.01	SM4500-NH ₃ -H	15-Jul-22/K	0.83	0.02		
Organic Nitrogen (Calculation)	mg/L	0.1	E3516.2	19-Jul-22/K	< 0.1	< 0.1	0.15	OG
Tannins and Lignins	mg/L	0.5	SM5500B	19-Jul-22/K	< 0.5	< 0.5		
Dissolved Organic Carbon	mg/L	0.2	EPA 415.2	14-Jul-22/O	1.5	1.4	5	AO
Phenolics	mg/L	0.001	MOEE 3179	18-Jul-22/K	< 0.001	< 0.001		
Sulphide	mg/L	0.01	SM4500-S2	14-Jul-22/K	0.01	< 0.01	0.05	AO
Hardness (as CaCO ₃)	mg/L	1	SM 3120	13-Jul-22/O	466	448	500,80-100	ODWO,OG
Calcium	mg/L	0.02	SM 3120	13-Jul-22/O	72.4	74.5		
Copper	mg/L	0.002	SM 3120	13-Jul-22/O	< 0.002	< 0.002	1	AO
Iron	mg/L	0.005	SM 3120	13-Jul-22/O	0.099	0.027	0.3	AO
Magnesium	mg/L	0.02	SM 3120	13-Jul-22/O	69.3	63.8		



R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

Steve Garrett
Director of Laboratory Services

C.O.C.: DW120181

REPORT No. B22-21987

Report To:

Malroz Engineering Inc.
 308 Wellington Street, 2nd Floor
 Kingston ON K7K 7A8 Canada

Attention: Jessie Payeur

DATE RECEIVED: 12-Jul-22

DATE REPORTED: 20-Jul-22

SAMPLE MATRIX: Drinking Water

Caduceon Environmental Laboratories

285 Dalton Ave
 Kingston Ontario K7K 6Z1
 Tel: 613-544-2001
 Fax: 613-544-2770

JOB/PROJECT NO.: 1645

P.O. NUMBER:

WATERWORKS NO.

			Client I.D.:	22-W003	22-W004	ODWS	
			Sample I.D.:	B22-21987-1	B22-21987-2	Objective	Type of Objective
			Date Collected:	12-Jul-22	12-Jul-22		
Parameter	Units	R.L.	Reference Method	Date/Site Analyzed			
Manganese	mg/L	0.001	SM 3120	13-Jul-22/O	0.024	0.001	0.05 AO
Potassium	mg/L	0.1	SM 3120	13-Jul-22/O	2.1	1.8	
Sodium	mg/L	0.2	SM 3120	13-Jul-22/O	37.3	28.9	200,20 AO,WL
Zinc	mg/L	0.005	SM 3120	13-Jul-22/O	0.017	0.019	5 AO
Silicon	mg/L	0.01	SM 3120	13-Jul-22/O	10.0	9.33	
Silica	mg/L	0.02	SM 3120	13-Jul-22/O	21.4	20.0	

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

Steve Garrett
 Director of Laboratory Services

C.O.C.: DW120183

REPORT No. B22-23223

Report To:

Malroz Engineering Inc.
308 Wellington Street, 2nd Floor
Kingston ON K7K 7A8 Canada

Attention: Jessie Payeur

DATE RECEIVED: 22-Jul-22

DATE REPORTED: 28-Jul-22

SAMPLE MATRIX: Drinking Water

Caduceon Environmental Laboratories

285 Dalton Ave
Kingston Ontario K7K 6Z1
Tel: 613-544-2001
Fax: 613-544-2770

JOB/PROJECT NO.: 1645

P.O. NUMBER:

WATERWORKS NO.

Parameter	Units	R.L.	Client I.D.:	22-W005	22-W006	ODWS		
			Sample I.D.:	B22-23223-1	B22-23223-2	Objective	Type of Objective	
			Date Collected:	21-Jul-22	21-Jul-22			
Total Coliform	cfu/100mL	1	MOE E3407	22-Jul-22/K	0	0	0	MAC
E coli	cfu/100mL	1	MOE E3407	22-Jul-22/K	0	0	0	MAC
Background	cfu/100mL	1	SM9222B	22-Jul-22/K	141	44		
Alkalinity(CaCO3) to pH4.5	mg/L	5	SM 2320B	22-Jul-22/O	463	450	30-500	OG
pH @25°C	pH Units		SM 4500H	22-Jul-22/O	8.16	8.15	6.5-8.5	OG
Conductivity @25°C	µmho/cm	1	SM 2510B	22-Jul-22/O	838	832		
Colour	TCU	2	SM 2120C	25-Jul-22/O	< 2	< 2	5	AO
Turbidity	NTU	0.1	SM 2130	18-Jul-22/O	6.4	5.6	5	AO
Fluoride	mg/L	0.1	SM4110C	22-Jul-22/O	0.3	0.3	1.5	MAC
Chloride	mg/L	0.5	SM4110C	22-Jul-22/O	4.5	5.7	250	AO
Nitrite (N)	mg/L	0.1	SM4110C	22-Jul-22/O	< 0.1	< 0.1	1	MAC
Nitrate (N)	mg/L	0.1	SM4110C	22-Jul-22/O	< 0.1	< 0.1	10	MAC
Sulphate	mg/L	1	SM4110C	22-Jul-22/O	22	24	500	AO
Total Kjeldahl Nitrogen	mg/L	0.1	E3516.2	26-Jul-22/K	0.3	0.3		
Ammonia + Ammonium (N)	mg/L	0.01	SM4500-NH3-H	25-Jul-22/K	0.16	0.15		
Organic Nitrogen (Calculation)	mg/L	0.1	E3516.2	28-Jul-22/K	0.1	0.1	0.15	OG
Tannins and Lignins	mg/L	0.5	SM5500B	26-Jul-22/K	< 0.5	< 0.5		
Dissolved Organic Carbon	mg/L	0.2	EPA 415.2	25-Jul-22/O	2.1	2.0	5	AO
Sulphide	mg/L	0.01	SM4500-S2	25-Jul-22/K	0.01	< 0.01	0.05	AO
Phenolics	mg/L	0.001	MOEE 3179	22-Jul-22/K	< 0.001	< 0.001		
Hardness (as CaCO3)	mg/L	1	SM 3120	22-Jul-22/O	440	426	500,80-100	ODWO,OG
Calcium	mg/L	0.02	SM 3120	22-Jul-22/O	72.1	70.9		
Copper	mg/L	0.002	SM 3120	22-Jul-22/O	< 0.002	< 0.002	1	AO
Iron	mg/L	0.005	SM 3120	22-Jul-22/O	0.674	0.691	0.3	AO
Magnesium	mg/L	0.02	SM 3120	22-Jul-22/O	63.1	60.6		

ODWS - Ontario Drinking Water Standards

AO - Aesthetic Objectives

IMAC - Interim Maximum Acceptable Concentration

MAC - Maximum Acceptable Concentration

ODWO - D-5-5 Objective

OG - Operational Guidelines

WL - Warning Level - Sodium Restricted Diets

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.



Michelle Dubien
Lab Manager

C.O.C.: DW120183

REPORT No. B22-23223

Report To:

Malroz Engineering Inc.
 308 Wellington Street, 2nd Floor
 Kingston ON K7K 7A8 Canada

Attention: Jessie Payeur

DATE RECEIVED: 22-Jul-22

DATE REPORTED: 28-Jul-22

SAMPLE MATRIX: Drinking Water

Caduceon Environmental Laboratories

285 Dalton Ave
 Kingston Ontario K7K 6Z1
 Tel: 613-544-2001
 Fax: 613-544-2770

JOB/PROJECT NO.: 1645

P.O. NUMBER:

WATERWORKS NO.

			Client I.D.:	22-W005	22-W006	ODWS	
			Sample I.D.:	B22-23223-1	B22-23223-2	Objective	Type of Objective
			Date Collected:	21-Jul-22	21-Jul-22		
Parameter	Units	R.L.	Reference Method	Date/Site Analyzed			
Manganese	mg/L	0.001	SM 3120	22-Jul-22/O	0.054	0.053	0.05 AO
Potassium	mg/L	0.1	SM 3120	22-Jul-22/O	2.4	2.4	
Sodium	mg/L	0.2	SM 3120	22-Jul-22/O	37.3	38.1	200,20 AO,WL
Silicon	mg/L	0.01	SM 3120	22-Jul-22/O	16.0	16.1	
Silica	mg/L	0.02	SM 3120	22-Jul-22/O	34.2	34.4	
Zinc	mg/L	0.005	SM 3120	22-Jul-22/O	< 0.005	< 0.005	5 AO

1. Sodium results are above the ODWS of 20mg/L

ODWS - Ontario Drinking Water Standards

AO - Aesthetic Objectives

IMAC - Interim Maximum Acceptable Concentration

MAC - Maximum Acceptable Concentration

ODWO - D-5-5 Objective

OG - Operational Guidelines

WL - Warning Level - Sodium Restricted Diets

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

Michelle Dubien
 Lab Manager



C.O.C.: DW120184

REPORT No. B22-23655

Report To:

Malroz Engineering Inc.
308 Wellington Street, 2nd Floor
Kingston ON K7K 7A8 Canada

Attention: Jessie Payeur

DATE RECEIVED: 26-Jul-22

DATE REPORTED: 03-Aug-22

SAMPLE MATRIX: Drinking Water

Caduceon Environmental Laboratories

285 Dalton Ave
Kingston Ontario K7K 6Z1
Tel: 613-544-2001
Fax: 613-544-2770

JOB/PROJECT NO.: 1645

P.O. NUMBER:

WATERWORKS NO.

Parameter	Units	R.L.	Client I.D.:		22-W007	22-W008	ODWS	
			Sample I.D.:		B22-23655-1	B22-23655-2	Objective	Type of Objective
			Date Collected:		26-Jul-22	26-Jul-22		
Total Coliform	cfu/100mL	1	MOE E3407	26-Jul-22/K	NDOGT ¹	NDOGT ¹	0	MAC
E coli	cfu/100mL	1	MOE E3407	26-Jul-22/K	NDOGT	NDOGT	0	MAC
Background	cfu/100mL	1	MOE E3407	26-Jul-22/K	NDOGT	NDOGT		
Alkalinity(CaCO ₃) to pH4.5	mg/L	5	SM 2320B	28-Jul-22/O	184	243	30-500	OG
pH @25°C	pH Units		SM 4500H	28-Jul-22/O	8.10	8.00	6.5-8.5	OG
Conductivity @25°C	µmho/cm	1	SM 2510B	28-Jul-22/O	977	576		
Colour	TCU	2	SM 2120C	28-Jul-22/O	< 2	< 2	5	AO
Turbidity	NTU	0.1	SM 2130	28-Jul-22/O	36.1	1.4	5	AO
Fluoride	mg/L	0.1	SM4110C	27-Jul-22/O	0.5	0.3	1.5	MAC
Chloride	mg/L	0.5	SM4110C	27-Jul-22/O	155	13.7	250	AO
Nitrite (N)	mg/L	0.1	SM4110C	27-Jul-22/O	< 0.1	< 0.1	1	MAC
Nitrate (N)	mg/L	0.1	SM4110C	27-Jul-22/O	< 0.1	2.2	10	MAC
Sulphate	mg/L	1	SM4110C	27-Jul-22/O	69	37	500	AO
Total Kjeldahl Nitrogen	mg/L	0.1	E3516.2	29-Jul-22/K	2.8	0.2		
Ammonia + Ammonium (N)	mg/L	0.01	SM4500-NH ₃ -H	28-Jul-22/K	2.24	0.05		
Organic Nitrogen (Calculation)	mg/L	0.1	E3516.2	02-Aug-22/K	0.5	0.1	0.15	OG
Dissolved Organic Carbon	mg/L	0.2	EPA 415.2	28-Jul-22/O	< 0.2	1.0	5	AO
Tannins and Lignins	mg/L	0.5	SM5500B	02-Aug-22/K	< 0.5	< 0.5		
Phenolics	mg/L	0.001	MOEE 3179	29-Jul-22/K	0.006	< 0.001		
Sulphide	mg/L	0.01	SM4500-S2	29-Jul-22/K	0.59	< 0.01	0.05	AO
Hardness (as CaCO ₃)	mg/L	1	SM 3120	27-Jul-22/O	181	269	500,80-100	ODWO,OG
Calcium	mg/L	0.02	SM 3120	27-Jul-22/O	55.0	78.5		
Copper	mg/L	0.002	SM 3120	27-Jul-22/O	< 0.002	< 0.002	1	AO
Iron	mg/L	0.005	SM 3120	27-Jul-22/O	1.54	0.152	0.3	AO
Magnesium	mg/L	0.02	SM 3120	27-Jul-22/O	10.6	17.6		

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

Michelle Dubien
Lab Manager



C.O.C.: DW120184

REPORT No. B22-23655

Report To:

Malroz Engineering Inc.
 308 Wellington Street, 2nd Floor
 Kingston ON K7K 7A8 Canada
Attention: Jessie Payeur

DATE RECEIVED: 26-Jul-22

DATE REPORTED: 03-Aug-22

SAMPLE MATRIX: Drinking Water

Caduceon Environmental Laboratories

285 Dalton Ave
 Kingston Ontario K7K 6Z1
 Tel: 613-544-2001
 Fax: 613-544-2770

JOB/PROJECT NO.: 1645

P.O. NUMBER:

WATERWORKS NO.

			Client I.D.:	22-W007	22-W008	ODWS	
			Sample I.D.:	B22-23655-1	B22-23655-2	Objective	Type of Objective
			Date Collected:	26-Jul-22	26-Jul-22		
Parameter	Units	R.L.	Reference Method	Date/Site Analyzed			
Manganese	mg/L	0.001	SM 3120	27-Jul-22/O	0.091	0.030	0.05 AO
Potassium	mg/L	0.1	SM 3120	27-Jul-22/O	1.8	1.6	
Silicon	mg/L	0.01	SM 3120	27-Jul-22/O	13.6	9.33	
Silica	mg/L	0.02	SM 3120	27-Jul-22/O	29.2	20.0	
Sodium	mg/L	0.2	SM 3120	27-Jul-22/O	127	21.6	200,20 AO,WL
Zinc	mg/L	0.005	SM 3120	27-Jul-22/O	< 0.005	< 0.005	5 AO

1. NDOGT = No Data; Overgrown with target bacteria.

2. Sodium result for sample #1 is above the ODWS of 20mg/L

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

Michelle Dubien
 Lab Manager



C.O.C.: Malroz Gan

REPORT No: 23-003059 - Rev. 0

Report To:

MacLellan Water Technology
388 Millhaven Rd,
P.O. Box 392
Odessa, ON K0H 2H0

CADUCEON Environmental Laboratories

285 Dalton Ave
Kingston, ON K7K 6Z1

Attention: William Vanderwilp

DATE RECEIVED: 2023-Feb-23

CUSTOMER PROJECT:

DATE REPORTED: 2023-Feb-27

P.O. NUMBER:

SAMPLE MATRIX: Drinking Water

Analyses	Qty	Site Analyzed	Authorized	Date Analyzed	Lab Method	Reference Method
Ecoli m-TECH Media (Liquid)	1	KINGSTON	ELIVERMORE	2023-Feb-23	EC-001	MECP E3371
Total Coliforms (m-Endo Media)	1	KINGSTON	ELIVERMORE	2023-Feb-23	TC-001	SM 9222B

R.L. = Reporting Limit

NC = Not Calculated

Test methods may be modified from specified reference method unless indicated by an *

Client I.D.	Sample I.D.	Date Collected	Parameter	Total Coliform	E coli
			Units	CFU/100mL	CFU/100mL
			R.L.	1	1
TWIII	23-003059-1	2023-Feb-22	-	0	0



Evan Livermore
Microbiology Supervisor

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

C.O.C.: Malroz Gan

REPORT No: 23-003060 - Rev. 0

Report To:

MacLellan Water Technology
388 Millhaven Rd,
P.O. Box 392
Odessa, ON K0H 2H0

CADUCEON Environmental Laboratories

285 Dalton Ave
Kingston, ON K7K 6Z1

Attention: William Vanderwilp

DATE RECEIVED: 2023-Feb-23

CUSTOMER PROJECT:

DATE REPORTED: 2023-Feb-27

P.O. NUMBER:

SAMPLE MATRIX: Drinking Water

Analyses	Qty	Site Analyzed	Authorized	Date Analyzed	Lab Method	Reference Method
Ecoli m-TECH Media (Liquid)	1	KINGSTON	ELIVERMORE	2023-Feb-23	EC-001	MECP E3371
Total Coliforms (m-Endo Media)	1	KINGSTON	ELIVERMORE	2023-Feb-23	TC-001	SM 9222B

R.L. = Reporting Limit

NC = Not Calculated

Test methods may be modified from specified reference method unless indicated by an *

Client I.D.	Sample I.D.	Date Collected	Parameter	Total Coliform	E coli
			Units	CFU/100mL	CFU/100mL
			R.L.	1	1
TWIV	23-003060-1	2023-Feb-22	-	0	0



Evan Livermore

Microbiology Supervisor

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.



The logo for the Ontario Ministry of the Environment. It features a stylized tree or leaf design inside a circle, with the word "Ontario" written in a script font below it.

The Official *Gas & Oil Resources* Web Site

WATER WELL RECORD

1 PRINT ONLY IN SPACES PROVIDED		2 CHECK <input checked="" type="checkbox"/> CORRECT BOX WHERE APPLICABLE <i>Test well #1</i>	
COUNTY OR DISTRICT <i>Leeds-Grenville</i>		TOWNSHIP BOROUGH CITY TOWN VILLAGE <i>Leeds</i>	
OWNER (SURNAME FIRST) <i>Regina, Peter</i>		ADDRESS <i>RR 2, Gananoque, Ontario K7G 2V4</i>	
		CON PLAT BLOCK TRACT SURVEY ETC <i>1 (#1 Building Lot 3)</i>	LOT <i>19-20</i>
		DATE COMPLETED <i>12 NO 11 '90</i>	

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

WATER RECORD	
WATER FOUND AT - FEET	KIND OF WATER
118	<input checked="" type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> GAS

CASING & OPEN HOLE RECORD				
INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 1/4	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC	3 16	0	22
	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			
	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			

SCREEN	SIZE(S) OF OPENING ISLOT NO. 1	DIAMETER	LENGTH																															
			INCHES	FEET																														
MATERIAL AND TYPE		DEPTH TO TOP OF SCREEN	FEET																															
<h3>PLUGGING & SEALING RECORD</h3> <table border="1"> <thead> <tr> <th colspan="2">DEPTH SET AT - FEET</th> <th>MATERIAL AND TYPE</th> <th colspan="2">CEMENT GROUT LEAD PACKER ETC</th> </tr> <tr> <th>FROM</th> <th>TO</th> <td colspan="3"></td> </tr> </thead> <tbody> <tr> <td>22</td> <td>2</td> <td colspan="3">Anchored Cement Grout</td> </tr> <tr> <td></td> <td></td> <td colspan="3"></td> </tr> <tr> <td></td> <td></td> <td colspan="3"></td> </tr> <tr> <td></td> <td></td> <td colspan="3"></td> </tr> </tbody> </table>					DEPTH SET AT - FEET		MATERIAL AND TYPE	CEMENT GROUT LEAD PACKER ETC		FROM	TO				22	2	Anchored Cement Grout																	
DEPTH SET AT - FEET		MATERIAL AND TYPE	CEMENT GROUT LEAD PACKER ETC																															
FROM	TO																																	
22	2	Anchored Cement Grout																																

PUMPING TEST	PUMPING TEST METHOD		PUMPING RATE 10 GPM	DURATION OF PUMPING 2 HOURS MIN	
	<input type="checkbox"/> PUMP	<input checked="" type="checkbox"/> BAILER		WATER LEVELS DURING PUMPING	
STATIC LEVEL 28 FEET	WATER LEVEL END OF PUMPING 90 FEET	15 MINUTES 42 FEET	30 MINUTES 53 FEET	45 MINUTES 61 FEET	60 MINUTES 66 FEET
IF FLOWING GIVE RATE GPM		PUMP INTAKE SET AT FEET		WATER AT END OF TEST <input checked="" type="checkbox"/> CLEAR <input type="checkbox"/> CLOUDY	
RECOMMENDED PUMP TYPE <input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP		RECOMMENDED PUMP SETTING 124 FEET	RECOMMENDED PUMPING RATE 10 GPM		

LOCATION OF WELL

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND
LOT LINE INDICATE NORTH BY ARROW.

N ↑

#3 #2
L^o + 22 L^o + 17
Commercial

#4 #5
L^o + 10 L^o + 10
Commercial

#1
L^o + 3

1000 Island Parkway → East 90051

FINAL STATUS OF WELL	<input checked="" type="checkbox"/> WATER SUPPLY <input type="checkbox"/> OBSERVATION WELL <input checked="" type="checkbox"/> TEST HOLE <input type="checkbox"/> RECHARGE WELL	<input type="checkbox"/> ABANDONED <input type="checkbox"/> INSUFFICIENT SUPPLY <input type="checkbox"/> ABANDONED POOR QUALITY <input type="checkbox"/> UNFINISHED <input type="checkbox"/> Dewatering
WATER USE	<input checked="" type="checkbox"/> DOMESTIC <input type="checkbox"/> STOCK <input type="checkbox"/> IRRIGATION <input type="checkbox"/> INDUSTRIAL <input type="checkbox"/> OTHER	<input type="checkbox"/> COMMERCIAL <input type="checkbox"/> MUNICIPAL <input type="checkbox"/> PUBLIC SUPPLY <input type="checkbox"/> COOLING OR AIR CONDITIONING <input type="checkbox"/> NOT USED
METHOD OF CONSTRUCTION	<input checked="" type="checkbox"/> CABLE TOOL <input type="checkbox"/> ROTARY (CONVENTIONAL) <input type="checkbox"/> ROTARY (REVERSE) <input type="checkbox"/> ROTARY (AIR) <input type="checkbox"/> AIR PERCUSSION	<input type="checkbox"/> BORING <input type="checkbox"/> DIAMOND <input type="checkbox"/> JETTING <input type="checkbox"/> DRIVING <input type="checkbox"/> DIGGING <input type="checkbox"/> OTHER

CONTRACTOR	NAME OF WELL CONTRACTOR <i>Jock Knox Well Drilling</i>	WELL CONTRACTOR <i>Jock Knox Well Drilling</i>
	ADDRESS <i>Glenburnie, Ontario</i>	ADDRESS <i>Ki 1150</i>
NAME OF WELL TECHNICIAN	NAME OF WELL TECHNICIAN <i>Ron Knox</i>	TECHNICIAN <i>10441</i>
	SIGNATURE OF TECHNICIAN/CONTRACTOR <i>Jock Knox</i>	SUBMISSION DAY <i>18</i>

CONTRACTOR'S COPY



The logo for the Ontario Ministry of the Environment. It features a circular emblem with a stylized three-leaf plant design inside, resembling a maple leaf. To the right of the emblem, the text "Ontario" is written in a bold, sans-serif font, and below it, "Ministry of the Environment" is written in a smaller, regular sans-serif font.

The Ohio Water Resources Act
WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED

CHECK CORRECT BOX WHERE APPLICABLE

Test Well #3

COUNTY OR DISTRICT

COUNTY OR DISTRICT Leeds Grenville	TOWNSHIP BOROUGH CITY TOWN VILLAGE Leeds	CON BLOCK TRACT SURVEY ETC 1 (# 3 Building lot 12)	LOT 19-20
OWNER(S) SURNAME FIRST Regina, Peter	ADDRESS R.R.2, Gananoque, Ontario K7G 2V4	DATE COMPLETED DAY 13 NO 11	IN 90

LOC OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

WATER RECORD

WATER FOUND AT - FEET	KIND OF WATER
60	<input checked="" type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> <input type="checkbox"/> GAS
118	<input checked="" type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> <input type="checkbox"/> GAS

CASING & OPEN HOLE RECORD

INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 $\frac{1}{4}$	<input checked="" type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC	$\frac{3}{16}$	0	26
	<input checked="" type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			
	<input checked="" type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			

SCREEN	SIZE(S) OF OPENING SLOT NO. 1	DIAMETER	LENGTH
		INCHES	FEET
MATERIAL AND TYPE		DEPTH TO TOP OF SCREEN	FEET
PLUGGING & SEALING RECORD			
DEPTH SLE AT - FEET		MATERIAL AND TYPE (CEMENT GROUT LEAD PACKER ETC.)	
THRU	TO		
26	2	Annular Cement Grout	

PLUGGING & SEALING RECORD

DEPTH SEE AT - FEET		MATERIAL AND TYPE	CEMENT GROUT LEAD PACKER ETC)
THRU	TO		
26	2	Annular Cement Grout	

LOCATION OF WELL

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND
LOT LINE. INDICATE NORTH BY ARROW.

PUMPING TEST METHOD		PUMPING RATE		DURATION OF PUMPING	
<input type="checkbox"/> PUMP	<input checked="" type="checkbox"/> BAILER	7 GPM		2 HOURS	
STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING			
16 FEET	110 FEET	15 MINUTES	30 MINUTES	45 MINUTES	60 MINUTES
		47 FEET	66 FEET	80 FEET	89 FEET
IF FLOWING, GIVE RATE		PUMP INTAKE SET AT		WATER AT END OF TEST	
		GPM	FEET	<input checked="" type="checkbox"/> CLEAR	<input type="checkbox"/> CLOUDY
RECOMMENDED PUMP TYPE		RECOMMENDED PUMP SETTING	119 FEET	RECOMMENDED PUMPING RATE	7 GPM
<input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP					

FINAL STATUS OF WELL	<input type="checkbox"/> WATER SUPPLY <input type="checkbox"/> OBSERVATION WELL <input checked="" type="checkbox"/> TEST WELL <input type="checkbox"/> RECHARGE WELL	<input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY <input type="checkbox"/> ABANDONED, POOR QUALITY <input type="checkbox"/> UNFINISHED <input type="checkbox"/> Dewatering
WATER USE	<input checked="" type="checkbox"/> DOMESTIC <input type="checkbox"/> STOCK <input type="checkbox"/> IRRIGATION <input type="checkbox"/> INDUSTRIAL <input type="checkbox"/> OTHER	<input type="checkbox"/> COMMERCIAL <input type="checkbox"/> MUNICIPAL <input type="checkbox"/> PUBLIC SUPPLY <input type="checkbox"/> COOLING OR AIR CONDITIONING <input type="checkbox"/> NOT USED
METHOD OF CONSTRUCTION	<input type="checkbox"/> CABLE TOOL <input type="checkbox"/> ROTARY (CONVENTIONAL) <input type="checkbox"/> ROTARY (REVERSE) <input type="checkbox"/> ROTARY (AIR) <input checked="" type="checkbox"/> AIR PERCUSSION	<input type="checkbox"/> BORING <input type="checkbox"/> DIAMOND <input type="checkbox"/> JETTING <input type="checkbox"/> DRIVING <input type="checkbox"/> DIGGING <input type="checkbox"/> OTHER

LOCATION OF WELL

N

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND
LOT LINE INDICATE NORTH BY ARROW.

#2
#1

#3
#4
Lot 22

Commercial
#7

#5
Lot 910

#1
#3

1000 Island Park Way → East 90052

CONTRACTOR	NAME OF WELL CONTRACTOR <i>Jack Knox Well Drilling</i>	WELL CONTRACTOR LICENSE NUMBER <i>3202</i>
	ADDRESS <i>Glenburne Ontario</i>	KOTIS
NAME OF WELL TECHNICIAN	<i>Ron Knox</i>	WELL TECHNICIAN LICENSE NUMBER <i>100474</i>
	SIGNATURE OF TECHNICIAN/CONTRACTOR <i>Jack Knox</i>	SUBMISSION DATE DAT <u> </u> NO <u> </u> TR <u> </u>

OFFICE USE ONLY				



The logo for the Ontario Ministry of the Environment. It features a circular emblem with a stylized tree or leaf design inside, with the word "Ontario" written in a script font below it.

The Ontario Water Resources Act

WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED
2. CHECK CORRECT BOX WHERE APPLICABLE

2 CHECK CORRECT BOX WHERE APPLICABLE test well #5

COUNTY OR DISTRICT	TOWNSHIP BOROUGH CITY TOWN VILLAGE	COR. ROCK EARTH SURVEY ETC	LOT
Leeds Grenville	Leeds	1 (#5 Building lot 90-90)	19-20
OWNER (SURNAME FIRST)	ADDRESS	DATE COMPLETED	
Regina, Peter	RR2 Gananoque, Ontario K7G 2V4	DAY 15	MO 11 YR 90

LOG OF OVERRBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

WATER RECORD

WATER FOUND AT - FEET	KIND OF WATER
63	<input checked="" type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> IRON <input type="checkbox"/> <input type="checkbox"/> CERAMIC <input type="checkbox"/> <input type="checkbox"/> GAS
147	<input checked="" type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> <input type="checkbox"/> CERAMIC <input type="checkbox"/> <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> <input type="checkbox"/> CERAMIC <input type="checkbox"/> <input type="checkbox"/> GAS
	<input type="checkbox"/> FRESH <input type="checkbox"/> SULPHUR <input type="checkbox"/> SALTY <input type="checkbox"/> MINERALS <input type="checkbox"/> <input type="checkbox"/> CERAMIC <input type="checkbox"/> <input type="checkbox"/> GAS

CASING & OPEN HOLE RECORD

INDIAN DIAM INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 1/4	<input checked="" type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC	3/16	0	41
	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			
	<input type="checkbox"/> STEEL <input type="checkbox"/> GALVANIZED <input type="checkbox"/> CONCRETE <input type="checkbox"/> OPEN HOLE <input type="checkbox"/> PLASTIC			

18

41 2 Annular Cement Grout

PUMPING TEST METHOD

<input type="checkbox"/> PUMP	<input type="checkbox"/> BAILER	12	CPM	2	HOURS	WATER
STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING		<input type="checkbox"/> PUMPING	<input type="checkbox"/> RECOVERY	
19 FEET	139 FEET	15 MINUTES 63 FEET	30 MINUTES 88 FEET	45 MINUTES 100 FEET	60 MINUTES 110 FEET	
IF FLOWING GIVE RATE		PUMP INTAKE SET AT		WATER AT END OF TEST		
	CPM	FEET		CLEAR	LOUD	
RECOMMENDED PUMP TYPE	RECOMMENDED PUMP SETTING	155 FEET		RECOMMENDED PUMPING RATE	12	CPM
<input type="checkbox"/> SHALLOW	<input type="checkbox"/> DEEP					

FINAL
STATUS
OF WELL

<input checked="" type="checkbox"/> WATER SUPPLY	<input type="checkbox"/> ABANDONED INSUFFICIENT SUPPLY
<input type="checkbox"/> OBSERVATION WELL	<input type="checkbox"/> ABANDONED POOR QUALITY
<input checked="" type="checkbox"/> TEST HOLE	<input type="checkbox"/> UNFINISHED
<input type="checkbox"/> RECHARGE WELL	<input type="checkbox"/> Dewatering
<input checked="" type="checkbox"/> DOMESTIC	<input type="checkbox"/> COMMERCIAL
<input type="checkbox"/> STOCK	<input type="checkbox"/> MUNICIPAL
<input type="checkbox"/> IRRIGATION	<input type="checkbox"/> PUBLIC SUPPLY

WATER

STOCK	<input type="checkbox"/> MUNICIPAL
IRRIGATION	<input type="checkbox"/> PUBLIC SUPPLY
INDUSTRIAL	<input type="checkbox"/> COOLING OR AIR CONDITIONING
OTHER	<input type="checkbox"/> NOT USED
<input checked="" type="checkbox"/> CABLE TOOL	<input type="checkbox"/> BORING
<input type="checkbox"/> ROTARY (CONVENTIONAL)	<input type="checkbox"/> DIAMOND
<input type="checkbox"/> ROTARY (REVERSE)	<input type="checkbox"/> JETTING
<input type="checkbox"/> ROTARY (AIR)	<input type="checkbox"/> DRIVING

METHOD
OF
CONSTRUCTION

<input checked="" type="checkbox"/> CABLE TOOL	<input type="checkbox"/> BORING
<input type="checkbox"/> ROTARY (CONVENTIONAL)	<input type="checkbox"/> DIAMOND
<input type="checkbox"/> ROTARY (REVERSE)	<input type="checkbox"/> JETTING
<input type="checkbox"/> ROTARY (AIR)	<input type="checkbox"/> DRIVING
<input checked="" type="checkbox"/> AIR PERCUSSION	<input type="checkbox"/> DIGGING
	<input type="checkbox"/> OTHER

CONTRACTOR 11

CONTRACTOR	NAME OF WELL CONTRACTOR	WELL CONTRACTOR LICENSE NUMBER
	JACK KNOX WELL DRILLING	3202
ADDRESS	GLENBURNIE, ONTARIO	
NAME OF WELL TECHNICIAN	KOHISO	
Arnold Munro	WELL TECHNICIAN'S LICENSE NUMBER	
SIGNATURE OF TECHNICIAN/CONTRACTOR	SUBMISSION DATE	
Jack Knox	DAY	MO
CONTRACTOR'S COPY		

110

OFFICE USE ONLY				



308 Wellington Street
2nd Floor
Kingston, ON K7K 7A8
Canada
613-548-3446
www.malroz.com

Via: email (contact@healthunit.org)

February 28, 2023
File: 1645.00-103

Dr. Linna Li
Medical Officer of Health
Leeds, Grenville and Lanark District Health Unit
458 Laurier Blvd
Brockville, ON K6V 7A3

Subject: Drinking Water Well Elevated Sodium Levels Part of Lots 19 & 20 Concession 1, Leeds and the Thousand Islands, Ontario

Dear Dr. Li,

We are sending this letter as notice that groundwater sampling and analysis from four potable residential drinking water wells located at Part of Lots 19 & 20 Concession 1, Leeds and the Thousand Islands, Ontario had reported sodium concentrations greater than 20 mg/L. In accordance with the Ontario Drinking Water Quality Standards, we are sending this letter so that this information can be provided to local physicians for their use with patients on sodium restricted diets that reside in this area and obtain drinking water from a water well.

Additional information is provided below:

- Groundwater sampling and analyses of the water wells was undertaken as part of a hydrogeological well assessment, which included a 6 hour pump test at each well to determine the water quantity and quality of the wells.
- Sampling was undertaken between July 11 and 26, 2022. A sample collected in the first hour of pumping and in the last hour of pumping had a reported concentration of 163 mg/L.
- Copies of the certificates of analysis, are attached.

Let us know if you have any questions or concerns with respect to this letter.

Yours truly,

Malroz Engineering Inc.

Per: John Pyke, P. Geo.
Geoscientist

Environmental Scientists & Engineers

KINGSTON ◊ TORONTO ◊ OTTAWA

encl.: Laboratory Certificates of Analysis and Water Well Records